

REPORT OF DRINKING WATER SAMPLING FOR LEAD CONTENT:

**GARRETT ELEMENTARY SCHOOL
1400 VILLE ROSA LANE
HAZELWOOD, MO 63042**



PREPARED FOR:

**MR. DAVID DUDLEY
DIRECTOR OF MAINTENANCE
HAZELWOOD SCHOOL DISTRICT
15875 NEW HALLS FERRY RD
FLORISSANT, MISSOURI 63031**

PREPARED BY:

**ENPAQ, LLC
3130 GRAVOIS AVENUE
ST. LOUIS, MISSOURI 63139**

JULY 2023

DOCUMENT TO BE RETAINED INDEFINITELY

TABLE OF CONTENTS

23-170

Drinking Water Sampling for Lead
Hazelwood School District
Garrett Elementary School
1400 Ville Rosa Lane
Hazelwood, MO 63042

EXECUTIVE SUMMARY

APPENDIX A Sample Locations/Results

APPENDIX B Laboratory Analysis

APPENDIX C Credentials

EXECUTIVE SUMMARY

ENPAQ, LLC performed lead testing of multiple drinking fountain water sources at the Garrett Elementary School located at 1400 Ville Rosa Lane in Hazelwood, Missouri. The sampling was performed by trained and licensed personnel in accordance with USEPA, HUD, and State of Missouri Regulations and Guidelines.

All inspectors involved with sampling activities had EPA-approved training in Lead. Credentials for our firm and the inspector collecting the samples are included in Attachment C to this document.

All samples were collected on a “first draw” basis. “First draw” is achieved by allowing the water system to rest for at least eight hours prior to sampling in order to collect any existing debris or settlement within the sample. The intent of this sampling is to replicate “worst-case scenario” conditions. As such, ENPAQ inspectors met at the school to collect water samples before the systems were used by staff or students. A second sample from each water source was collected as a “follow-up” sample basis. “Follow-up” sampling is achieved by allowing the water system to run for thirty (30) seconds after the first draw sampling. The intent of this sampling is to determine if lead contamination may be in the water lines connected to the water sources and not just at the fixture. The sampling was completed in accordance with the Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* requirements. The Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* and other regulatory agencies recommend that water sources run for at least thirty seconds and as long as two minutes prior to use to avoid settling within the water system.

Drinking water samples were collected from fifteen (15) different locations throughout Garrett Elementary School during the sampling event. The water samples were collected from drinking fountains utilized for drinking activities at the campus. After sample collection, samples were immediately delivered to Teklab, Inc. located in Collinsville, Illinois following strict chain of custody procedures. Teklab is a NELAP-accredited and State of Missouri-licensed laboratory specializing in drinking water analysis. Detailed sampling locations and sample results are located in Attachment A of this report.

Any samples reported over 5.0 ppb should be re-sampled on an annual basis at a minimum.

CONCLUSION/RECOMMENDATIONS

At this time, ENPAQ recommends that all water sources testing at 5.0 ppb or above be removed from service. These sources are subject to additional maintenance activities and remediation prior to use. Before being put back into service, it is recommended these sources be re-tested to confirm compliance with acceptable levels.

Remediation includes decreasing lead concentrations below 5 parts per billion using methods such as replacement of plumbing, solder, fittings, or fixtures, installation of filters and filter devices, or other effective methods in accordance with Missouri SB681 *Get the Lead Out of Schools Drinking Water Act*.

In addition, all sources will be subject to an ongoing maintenance program and re-testing at appropriate intervals. **Any samples reported over 5.0 ppb should be re-sampled on an annual basis at a minimum.**

Although no additional samples were identified above the action level, ENPAQ recommends that all water sources run for at least thirty seconds prior to use as recommended by the USEPA.

APPENDIX A

SAMPLE LOCATIONS & RESULTS

Prep Day: 7/24/23

Sample Day: 7/25/23

To Lab -----> 7/25/23

* Reporting Limit

| | |
|----------------|-----------|
| # Disabled = | 3 |
| # of Samples = | 30 |
| # > 10.0 ppb = | 0 |
| # > 0.5 ppb = | 0 |


| Source | Sample ID # | Sample Type | Sample Location | Source Notes | RL * | Lead Test Result |
|--------|-------------|-------------|-------------------------------|--------------|------|------------------|
| 01 | (A) | S | Kitchen Prep Sink - Left | | 1.0 | <1.0 ppb |
| | (B) | S | Kitchen Prep Sink - Left | | 1.0 | <1.0 ppb |
| | (C) | | | | 1.0 | N/A ppb |
| 02 | (A) | S | Kitchen Prep Sink - Right | | 1.0 | <1.0 ppb |
| | (B) | S | Kitchen Prep Sink - Right | | 1.0 | <1.0 ppb |
| 03 | (A) | S | Pot Filler | | 1.0 | 1.8 ppb |
| | (B) | S | Pot Filler | | 1.0 | <1.0 ppb |
| 04 | (A) | S | Dishwashing Sink | | 1.0 | 3.4 ppb |
| | (B) | S | Dishwashing Sink | | 1.0 | <1.0 ppb |
| 05 | (A) | F | Café Fountain (Inactive) | | 1.0 | N/A ppb |
| | (B) | F | Café Fountain (Inactive) | | 1.0 | N/A ppb |
| 06 | (A) | S | Nurse Office | | 1.0 | <1.0 ppb |
| | (B) | S | Nurse Office | | 1.0 | <1.0 ppb |
| 07 | (A) | S | Teachers Lounge | | 1.0 | <1.0 ppb |
| | (B) | S | Teachers Lounge | | 1.0 | <1.0 ppb |
| 08 | (A) | S | Hallway Sink O/S Café - Left | | 1.0 | <1.0 ppb |
| | (B) | S | Hallway Sink O/S Café - Left | | 1.0 | <1.0 ppb |
| 09 | (A) | S | Hallway Sink O/S Café - Right | | 1.0 | <1.0 ppb |
| | (B) | S | Hallway Sink O/S Café - Right | | 1.0 | <1.0 ppb |
| 10 | (A) | F | Fountain O/S Café | | 1.0 | <1.0 ppb |
| | (B) | F | Fountain O/S Café | | 1.0 | <1.0 ppb |
| 11 | (A) | S | Hallway Sink O/S Main Office | | 1.0 | 1.2 ppb |
| | (B) | S | Hallway Sink O/S Main Office | | 1.0 | <1.0 ppb |

(Continuation Sheet)

| Source | Sample ID # | Sample Type | Sample Location | Source Notes | RL * | Lead Test Result |
|--------|-------------|-------------|---|--------------|------|------------------|
| 12 | (A) | F | Fountain O/S Main Office | | 1.0 | <1.0 ppb |
| | (B) | F | Fountain O/S Main Office | | 1.0 | <1.0 ppb |
| 13 | (A) | F | Fountain O/S Room 21 - Left (Inactive) | | 1.0 | N/A ppb |
| | (B) | F | Fountain O/S Room 21 - Left (Inactive) | | 1.0 | N/A ppb |
| 14 | (A) | F | Fountain O/S Room 21 - Right (Inactive) | | - | N/A ppb |
| | (B) | F | Fountain O/S Room 21 - Right (Inactive) | | - | N/A ppb |
| 15 | (A) | F | Fountain O/S Room 42 | | 1.0 | <1.0 ppb |
| | (B) | F | Fountain O/S Room 42 | | 1.0 | <1.0 ppb |
| 16 | (A) | F | Fountain - Gym | | 1.0 | <1.0 ppb |
| | (B) | F | Fountain - Gym | | 1.0 | 1.7 ppb |

Sample ID Coding Key:


- F = Fountain
- S = Sink
- (A) = 1st Sample
- (B) = 2nd Sample (30 Seconds Later)
- (C) = 3rd Sample (3 Minutes Later)

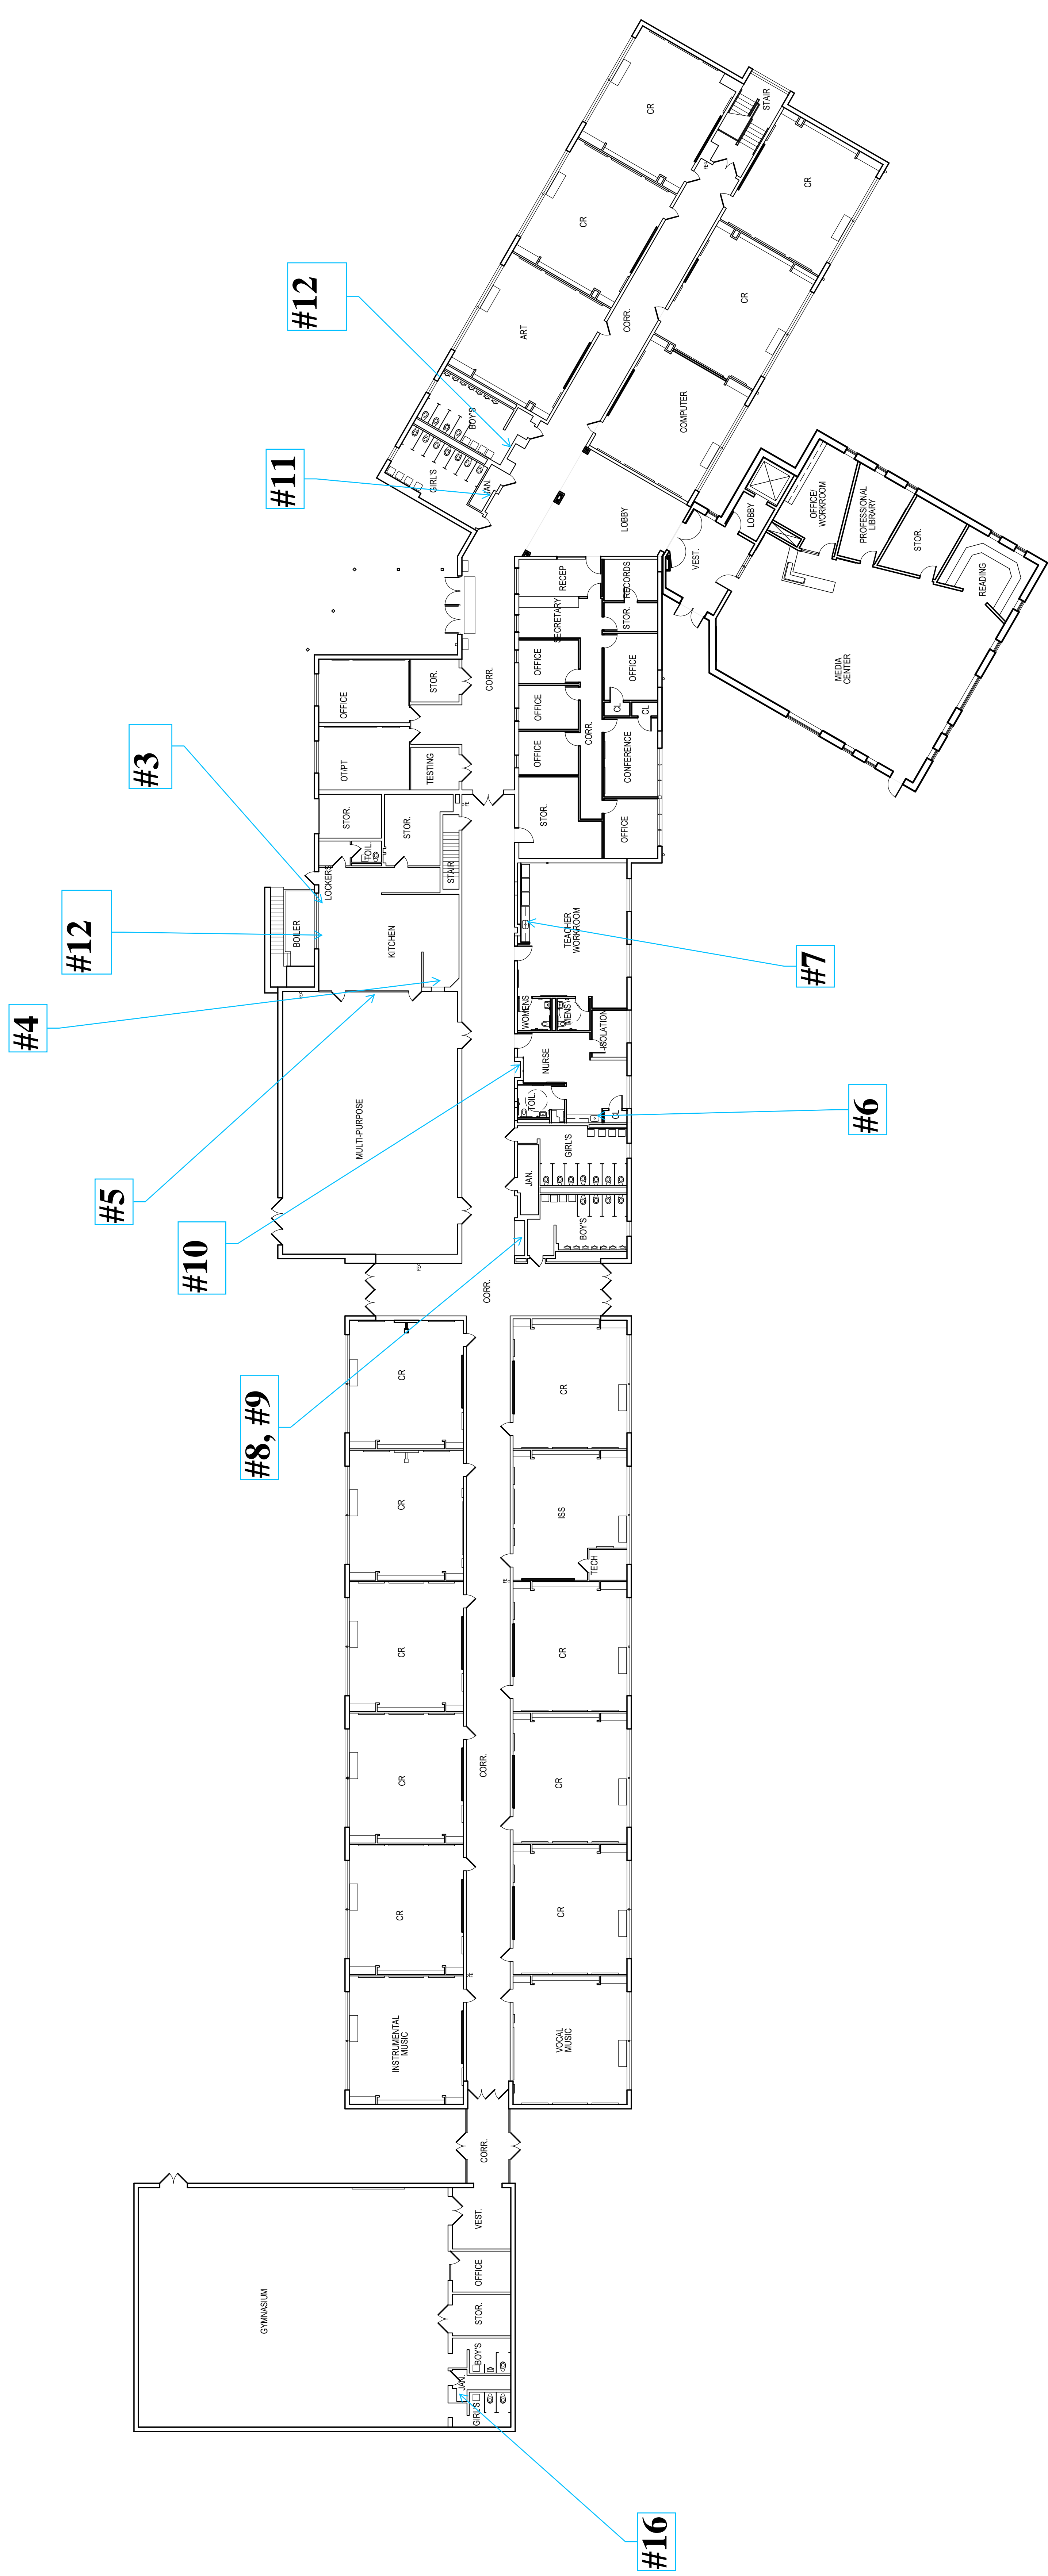


1ST FLOOR PLAN

GARRETT ELEMENTARY SCHOOL

HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI
21-100 03-09-2021

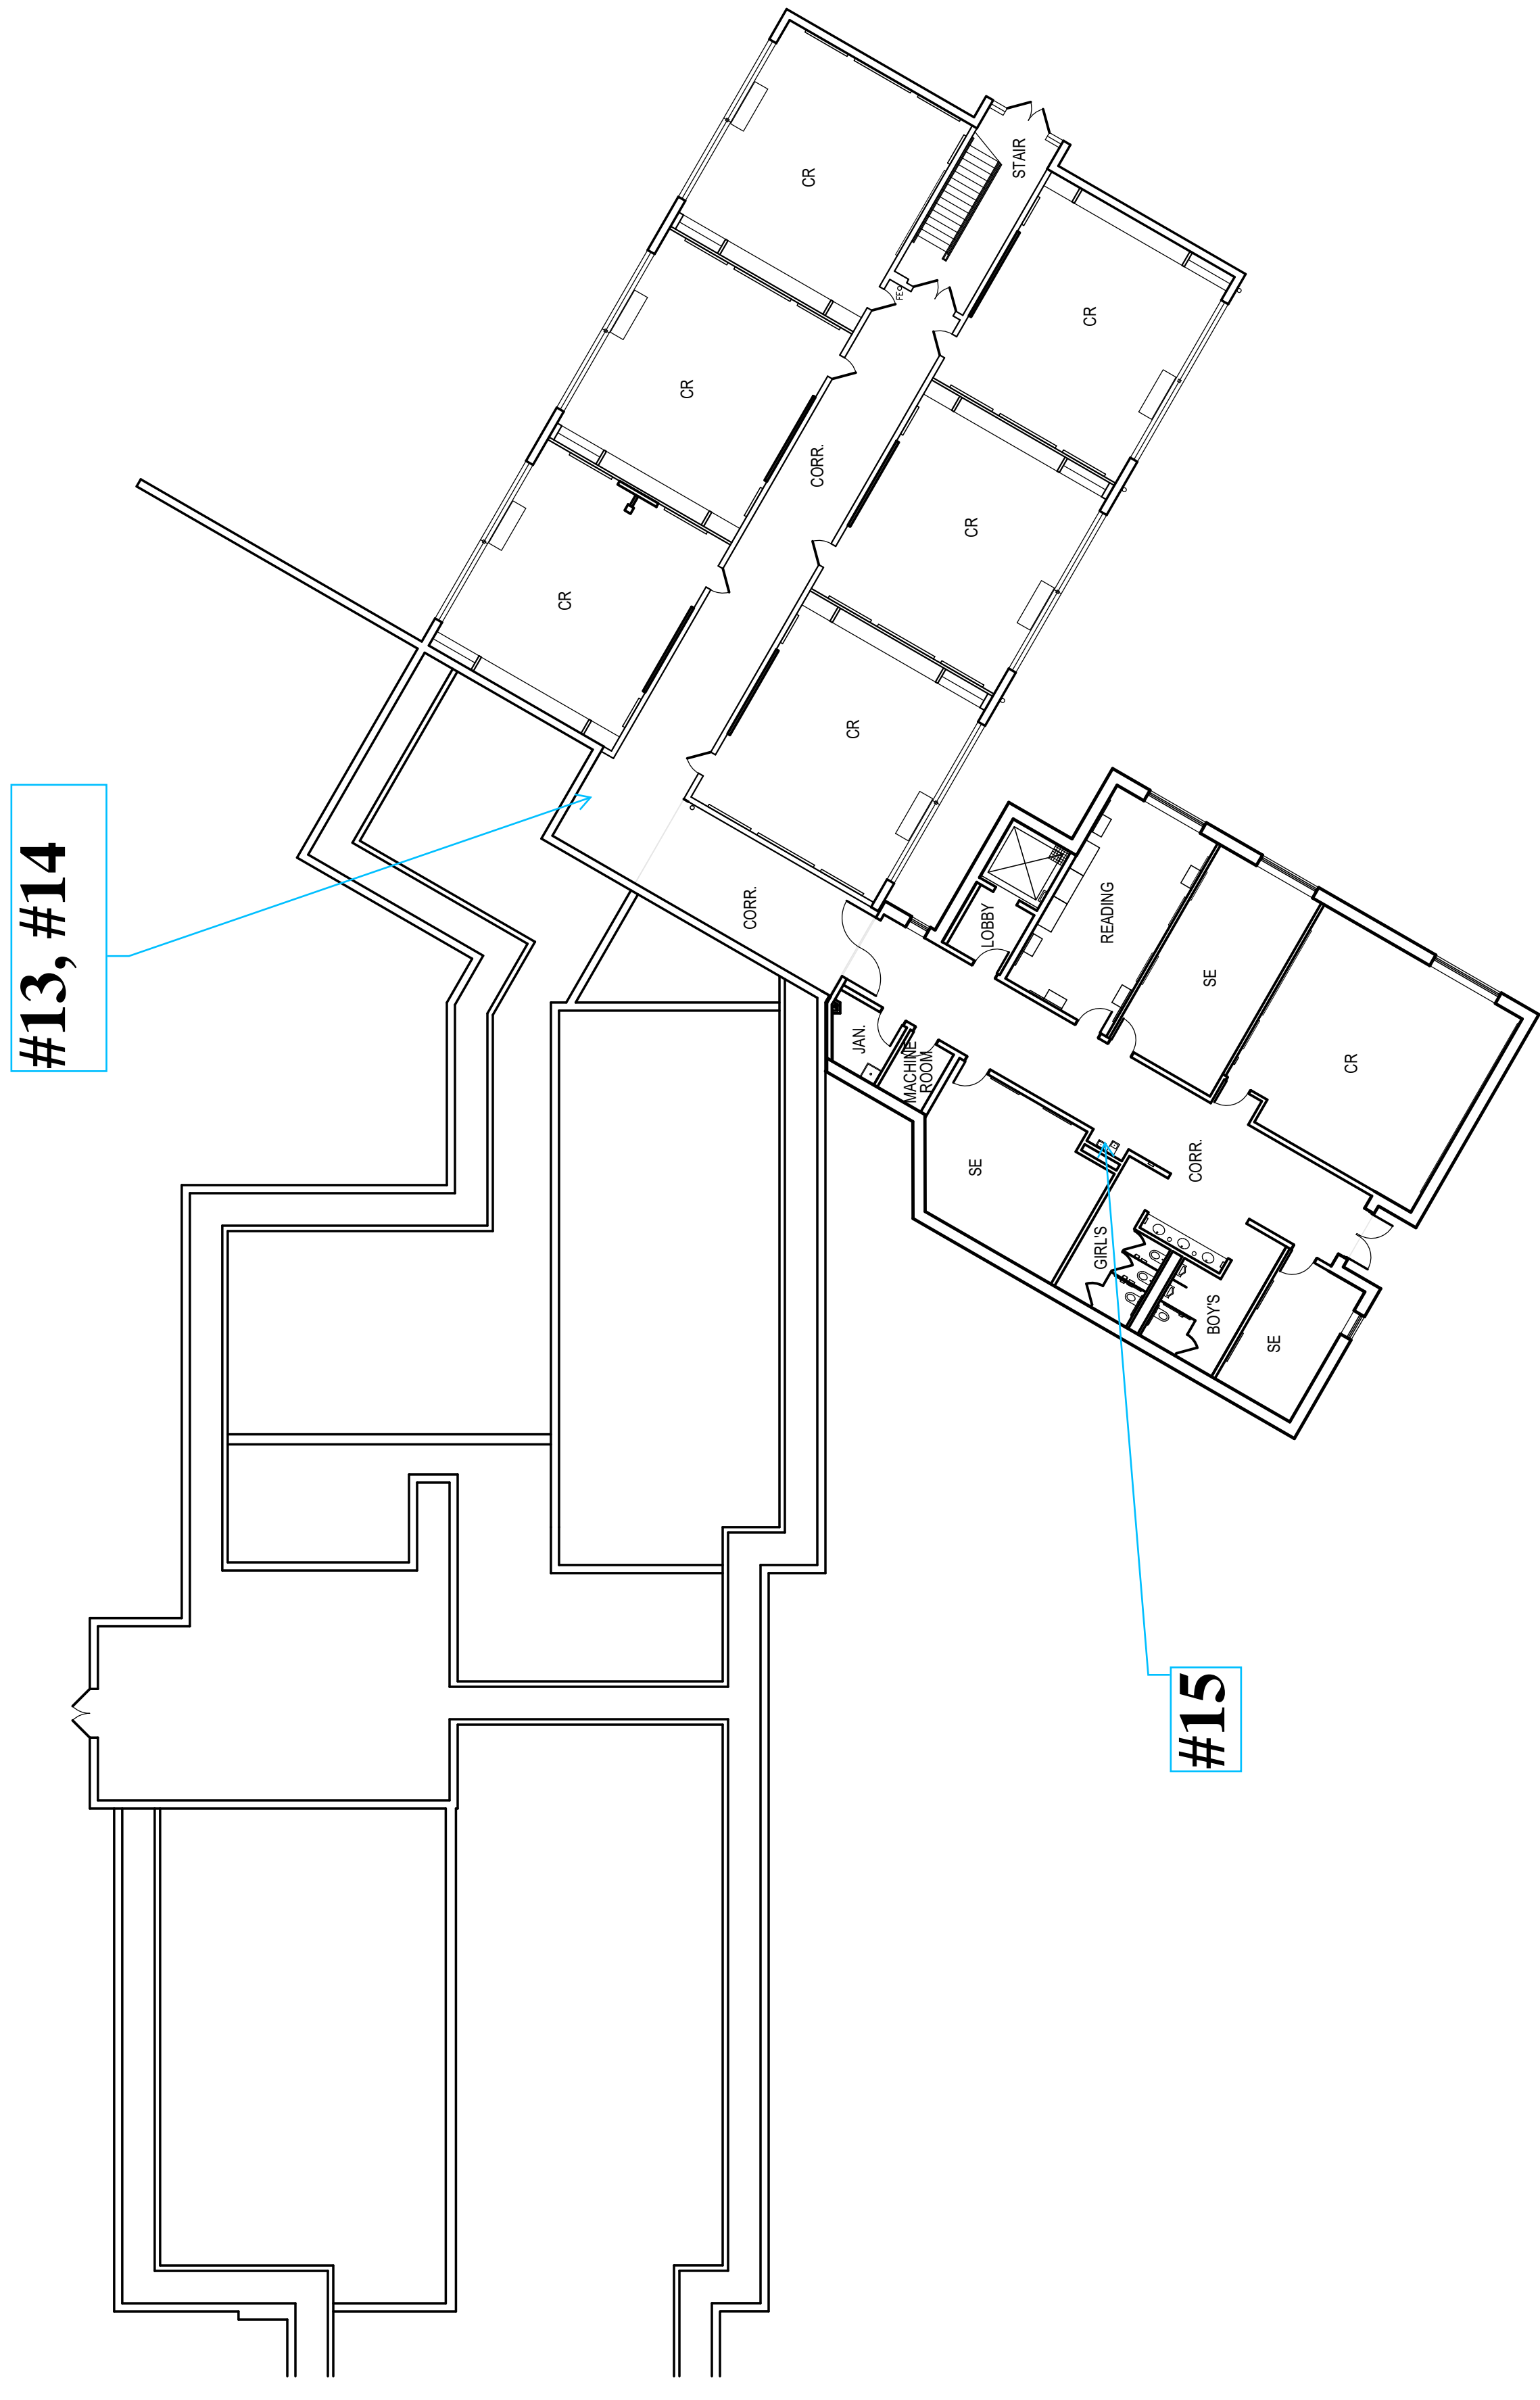

GROUND FLOOR PLAN

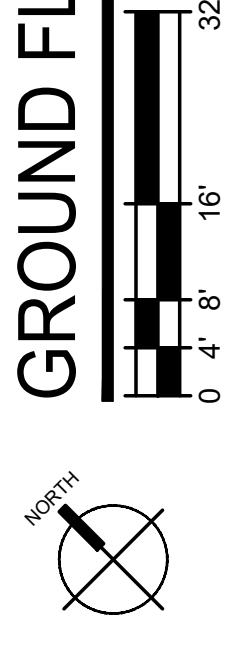

GARRETT ELEMENTARY SCHOOL

HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI
21-100 03-09-2021

APPENDIX B

LABORATORY ANALYSIS

September 07, 2023

Tony Hagerty
ENPAQ, LLC
3130 Gravois Ave
St. Louis, MO 63118
TEL: (314) 449-1976
FAX:



| | |
|-----------|---------|
| Illinois | 100226 |
| Kansas | E-10374 |
| Louisiana | 05002 |
| Louisiana | 05003 |
| Oklahoma | 9978 |

RE: Hazelwood SD/23-170 Garrett Elem

WorkOrder: 23071730

Dear Tony Hagerty:

TEKLAB, INC received 30 samples on 7/25/2023 11:18:00 AM for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Marvin L. Darling
Project Manager
(618)344-1004 ex 41
mdarling@teklabinc.com



Report Contents

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

This reporting package includes the following:

| | |
|----------------------|----------|
| Cover Letter | 1 |
| Report Contents | 2 |
| Definitions | 3 |
| Case Narrative | 5 |
| Accreditations | 6 |
| Laboratory Results | 7 |
| Receiving Check List | 37 |
| Chain of Custody | Appended |

Client: ENPAQ, LLC**Work Order:** 23071730**Client Project:** Hazelwood SD/23-170 Garrett Elem**Report Date:** 07-Sep-23**Abbr Definition**

* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count (> 200 CFU)

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Qualifiers

- | | |
|---|--|
| # - Unknown hydrocarbon | B - Analyte detected in associated Method Blank |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range |
| H - Holding times exceeded | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits | M - Manual Integration used to determine area response |
| ND - Not Detected at the Reporting Limit | R - RPD outside accepted recovery limits |
| S - Spike Recovery outside recovery limits | T - TIC(Tentatively identified compound) |
| X - Value exceeds Maximum Contaminant Level | |



Case Narrative

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Cooler Receipt Temp: N/A °C

Locations

Collinsville

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425
Phone (618) 344-1004
Fax (618) 344-1005
Email jhriley@teklabinc.com

Collinsville Air

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425
Phone (618) 344-1004
Fax (618) 344-1005
Email EHurley@teklabinc.com

Springfield

Address 3920 Pintail Dr
Springfield, IL 62711-9415
Phone (217) 698-1004
Fax (217) 698-1005
Email KKlostermann@teklabinc.com

Chicago

Address 1319 Butterfield Rd.
Downers Grove, IL 60515
Phone (630) 324-6855
Fax
Email arenner@teklabinc.com

Kansas City

Address 8421 Nieman Road
Lenexa, KS 66214
Phone (913) 541-1998
Fax (913) 541-1998
Email jhriley@teklabinc.com

Client: ENPAQ, LLC**Work Order:** 23071730**Client Project:** Hazelwood SD/23-170 Garrett Elem**Report Date:** 07-Sep-23

| State | Dept | Cert # | NELAP | Exp Date | Lab |
|-----------|------|---------|-------|-----------|--------------|
| Illinois | IEPA | 100226 | NELAP | 1/31/2024 | Collinsville |
| Kansas | KDHE | E-10374 | NELAP | 4/30/2024 | Collinsville |
| Louisiana | LDEQ | 05002 | NELAP | 6/30/2024 | Collinsville |
| Louisiana | LDEQ | 05003 | NELAP | 6/30/2024 | Collinsville |
| Oklahoma | ODEQ | 9978 | NELAP | 8/31/2023 | Collinsville |
| Arkansas | ADEQ | 88-0966 | | 3/14/2024 | Collinsville |
| Illinois | IDPH | 17584 | | 5/31/2025 | Collinsville |
| Iowa | IDNR | 430 | | 6/1/2024 | Collinsville |
| Kentucky | UST | 0073 | | 1/31/2024 | Collinsville |
| Missouri | MDNR | 00930 | | 5/31/2023 | Collinsville |
| Missouri | MDNR | 930 | | 1/31/2025 | Collinsville |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-001

Client Sample ID: 01A

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/31/2023 11:23 | 210357 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-002

Client Sample ID: 01B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 16:02 | 210357 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-003

Client Sample ID: 02A

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 16:07 | 210357 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-004

Client Sample ID: 02B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 16:11 | 210357 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-005

Client Sample ID: 03A

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.8 | µg/L | 1 | 08/29/2023 16:16 | 210357 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-006

Client Sample ID: 03B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 16:47 | 210357 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-007

Client Sample ID: 04A

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 3.4 | µg/L | 1 | 08/29/2023 16:52 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-008

Client Sample ID: 04B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 16:56 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-009

Client Sample ID: 06A

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 17:01 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-010

Client Sample ID: 06B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 17:05 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-011

Client Sample ID: 07

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 17:19 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-012

Client Sample ID: 07

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 17:10 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-013

Client Sample ID: 08

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 17:14 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-014

Client Sample ID: 08

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 17:46 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-015

Client Sample ID: 09

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 17:50 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-016

Client Sample ID: 09

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 17:55 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-017

Client Sample ID: 10

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 17:59 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-018

Client Sample ID: 10

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 18:04 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-019

Client Sample ID: 11A

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.2 | µg/L | 1 | 08/29/2023 18:08 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-020

Client Sample ID: 11B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 18:13 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-021

Client Sample ID: 12A

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 18:17 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-022

Client Sample ID: 12B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 08/29/2023 18:44 | 210359 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-023

Client Sample ID: 13A

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|---|---------------|-----|------|-----------|-------|----|-----------------|---------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | Lab error | µg/L | 1 | 08/28/2023 0:00 | R335605 |
| Lab error - unable to locate sample fraction for analysis | | | | | | | | |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-024

Client Sample ID: 13B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|---|---------------|-----|------|-----------|-------|----|-----------------|---------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | Lab error | µg/L | 1 | 08/28/2023 0:00 | R335605 |
| Lab error - unable to locate sample fraction for analysis | | | | | | | | |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-025

Client Sample ID: 14A

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|---|---------------|-----|------|-----------|-------|----|-----------------|---------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | Lab error | µg/L | 1 | 08/28/2023 0:00 | R335605 |
| Lab error - unable to locate sample fraction for analysis | | | | | | | | |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-026

Client Sample ID: 14B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|---|---------------|-----|------|-----------|-------|----|-----------------|---------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | Lab error | µg/L | 1 | 08/28/2023 0:00 | R335605 |
| Lab error - unable to locate sample fraction for analysis | | | | | | | | |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-027

Client Sample ID: 15A

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/03/2023 0:01 | 210566 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-028

Client Sample ID: 15B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/02/2023 10:58 | 210498 |

Client: ENPAQ, LLC**Work Order:** 23071730**Client Project:** Hazelwood SD/23-170 Garrett Elem**Report Date:** 07-Sep-23**Lab ID:** 23071730-029**Client Sample ID:** 16A**Matrix:** DRINKING WATER**Collection Date:** 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|---|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/02/2023 11:01 | 210498 |



Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Lab ID: 23071730-030

Client Sample ID: 16B

Matrix: DRINKING WATER

Collection Date: 07/25/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|--|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.7 | µg/L | 1 | 09/02/2023 11:12 | 210498 |



Receiving Check List

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071730

Client Project: Hazelwood SD/23-170 Garrett Elem

Report Date: 07-Sep-23

Carrier: Employee

Received By: MBP

Completed by:

Reviewed by:

On:

On:

27-Jul-23

27-Jul-23

Lindsey Maddox

Ellie Hopkins

Pages to follow:

Chain of custody

3

Extra pages included

2

Shipping container/cooler in good condition?

Yes ☒

No ☐

Not Present ☐

Temp °C N/A

Type of thermal preservation?

None ☒

Ice ☐

Blue Ice ☐

Dry Ice ☐

Chain of custody present?

Yes ☒

No ☐

Chain of custody signed when relinquished and received?

Yes ☒

No ☐

Chain of custody agrees with sample labels?

Yes ☒

No ☐

Samples in proper container/bottle?

Yes ☒

No ☐

Sample containers intact?

Yes ☒

No ☐

Sufficient sample volume for indicated test?

Yes ☒

No ☐

All samples received within holding time?

Yes ☒

No ☐

Reported field parameters measured:

Field ☐

Lab ☐

NA ☒

Container/Temp Blank temperature in compliance?

Yes ☒

No ☐

When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.

Water – at least one vial per sample has zero headspace?

Yes ☐

No ☐

No VOA vials ☒

Water - TOX containers have zero headspace?

Yes ☐

No ☐

No TOX containers ☒

Water - pH acceptable upon receipt?

Yes ☒

No ☐

NA ☐

NPDES/CWA TCN interferences checked/treated in the field?

Yes ☐

No ☐

NA ☒

Any No responses must be detailed below or on the COC.

Samples were checked for turbidity and then preserved with nitric acid upon arrival in the laboratory. - lmaddox - 7/27/2023 11:19:08 AM

Pg 1 of 3 Workorder # 23071730

Client: ENPAQ, LLC
Address: 3130 Gravois Ave.
City/State/Zip: Collinsville, IL 62234
Contact: Anthony Hagerty Phone: (314) 449-1976
Email: tony.hagerty@enpaqconsulting.com Fax: _____

Samples on: ☐ ICE ☐ BLUE ICE ☒ NO ICE NA °C
Preserved in: ☒ LAB ☐ FIELD FOR LAB USE ONLY
LAB NOTES:

Client Comments:
Please Report in PPB

Garrett & Elen

Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No

Are these samples known to be hazardous? ☐ Yes ☒ No

Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No

PROJECT NAME/NUMBER
Hazelwood SD/ 23-170

SAMPLE COLLECTOR'S NAME

and Type of Containers

INDICATE ANALYSIS REQUESTED

RESULTS REQUESTED

BILLING INSTRUCTIONS

| | |
|--|---|
| <input checked="" type="checkbox"/> Standard | <input type="checkbox"/> 1-2 Day (100% Surcharge) |
| <input type="checkbox"/> Other _____ | <input type="checkbox"/> 3 Day (50% Surcharge) |

| Lab Use Only | Sample ID | Date/Time Sampled | Matrix |
|---------------|--------------------|-------------------|---------|
| 13071730 -001 | 01A | 7/25/23 | Aqueous |
| -002 | 01B | | Aqueous |
| -003 | 02A | | Aqueous |
| -004 | 02B | | Aqueous |
| -005 | 03A | | Aqueous |
| -006 | 03B | | Aqueous |
| -007 | 04A | | Aqueous |
| -008 | 04B | | Aqueous |
| -009 | 05A 06A | | Aqueous |
| -010 | 05B 06B | | Aqueous |
| | | | Aqueous |

[illegible]

Relinquished By

Date/Time

Received By

Date/Time

A. H. K.

7/25/23

Мохамед Абду

7125123 119

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

Pg 2 of 3 Workorder # 23071730

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

| | | | | | | | |
|--|------------|---|----------------|---|--|----------------------------------|--|
| Client: <u>ENPAQ, LLC</u> Address: <u>3130 Gravois Ave.</u> City/State/Zip: <u>Collinsville, IL 62234</u> Contact: <u>Anthony Hagerty</u> Phone: <u>(314) 449-1976</u> Email: <u>tony.hagerty@enpaqconsulting.com</u> Fax: _____ | | | | Samples on: <input type="checkbox"/> ICE <input type="checkbox"/> BLUE ICE <input type="checkbox"/> NO ICE _____ °C Preserved in: <input type="checkbox"/> LAB <input type="checkbox"/> FIELD <u>FOR LAB USE ONLY</u> LAB NOTES: Client Comments: Please Report in PPB <div style="font-size: 1.5em; margin-top: 10px;">Garrett Elem</div> | | | |
| Are these samples known to be involved in litigation? If yes, a surcharge will apply: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Are these samples known to be hazardous? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | | | | # and Type of Containers | | | |
| PROJECT NAME/NUMBER <u>Hazelwood SD/ 23-170</u> | | SAMPLE COLLECTOR'S NAME <u>Anthony Hagerty</u> | | INDICATE ANALYSIS REQUESTED | | | |
| RESULTS REQUESTED <input checked="" type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) <input type="checkbox"/> Other _____ <input type="checkbox"/> 3 Day (50% Surcharge) | | BILLING INSTRUCTIONS | | UNP HNO3 NaOH H2SO4 HCL MeOH NaHSO4 TSP Other | | | |
| Lab Use Only | Sample ID | Date/Time Sampled | Matrix | | | | |
| <u>23071730-011</u> | <u>07</u> | <u>7/25/23</u> | <u>Aqueous</u> | <u>X</u> | | | |
| <u>012</u> | <u>07</u> | ↓ | <u>Aqueous</u> | | | | |
| <u>013</u> | <u>08</u> | | <u>Aqueous</u> | | | | |
| <u>014</u> | <u>08</u> | | <u>Aqueous</u> | | | | |
| <u>015</u> | <u>09</u> | | <u>Aqueous</u> | | | | |
| <u>016</u> | <u>09</u> | | <u>Aqueous</u> | | | | |
| <u>017</u> | <u>10</u> | | <u>Aqueous</u> | | | | |
| <u>018</u> | <u>10</u> | | <u>Aqueous</u> | | | | |
| <u>019</u> | <u>11A</u> | | | <u>Aqueous</u> | | | |
| <u>020</u> | <u>11B</u> | | <u>Aqueous</u> | | | | |
| <u>8</u> | | | <u>Aqueous</u> | | | | |
| Relinquished By <u>A. Hagerty</u> | | Date/Time <u>7/25/23</u> | | Received By <u>Maryann Peten</u> | | Date/Time <u>7/25/23 1118</u> | |

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|---|--|---|--|---|--|---------|--|-----------------------------|--|--|--|--------------|--|--|--|------|--|--|--|-------|--|--|--|-----|--|--|--|------|--|--|--|--------|--|--|--|-----|--|--|--|-------|--|--|--|
| Client: ENPAQ, LLC | | | | Samples on: <input type="checkbox"/> ICE <input type="checkbox"/> BLUE ICE <input type="checkbox"/> NO ICE _____ °C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Address: 3130 Gravois Ave. | | | | Preserved in: <input type="checkbox"/> LAB <input type="checkbox"/> FIELD <u>FOR LAB USE ONLY</u> | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| City/State/Zip: Collinsville, IL 62234 | | | | LAB NOTES: | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Contact: Anthony Hagerty | | | | Phone: (314) 449-1976 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Email: tony.hagerty@enpaqconsulting.com | | | | Fax: | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Are these samples known to be involved in litigation? If yes, a surcharge will apply: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No | | | | Client Comments: | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Are these samples known to be hazardous? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No | | | | Please Report in PPB | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | | | | Garrett Elem | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| PROJECT NAME/NUMBER | | SAMPLE COLLECTOR'S NAME | | # and Type of Containers | | | | INDICATE ANALYSIS REQUESTED | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Hazelwood SD/ 23-170 | | Anthony Hagerty | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| RESULTS REQUESTED | | BILLING INSTRUCTIONS | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| <input checked="" type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) | | <input type="checkbox"/> Other <input type="checkbox"/> 3 Day (50% Surcharge) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Lab Use Only | | Sample ID | | Date/Time Sampled | | Matrix | | UNP | | | | HNO3 | | | | NaOH | | | | H2SO4 | | | | HCL | | | | MeOH | | | | NaHSO4 | | | | TSP | | | | Other | | | |
| 13071730-021 | | 12 A | | 7/25/23 | | Aqueous | | X | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 022 | | 12 B | | | | Aqueous | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 023 | | 13 A | | | | Aqueous | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 024 | | 13 B | | | | Aqueous | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 025 | | 14 A | | | | Aqueous | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 026 | | 14 B | | | | Aqueous | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 027 | | 15 A | | | | Aqueous | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 028 | | 15 B | | | | Aqueous | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 029 | | 16 A | | | | Aqueous | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 030 | | 16 B | | | | Aqueous | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | Aqueous | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Relinquished By | | | | Date/Time | | | | Received By | | | | Date/Time | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Anthony Hagerty | | | | 7/25/23 | | | | Monique Peltier | | | | 7/25/23 1118 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

Prep Day: 7/24/23

Sample Day: 7/25/23

To Lab -----> 7/25/23

to Test =

Disabled =

of Samples =

> 10.0 ppb =

> 0.5 ppb =

* Reporting Limit

| Source | Sample ID # | Sample Type | Sample Location | Source Notes | RL * | Lead Test Result |
|--------|-------------|-------------|-------------------------------|--------------|------|------------------|
| 01 | (A) | S | Kitchen Prep Sink - Left | | 1.0 | ppb |
| | (B) | S | Kitchen Prep Sink - Left | | 1.0 | 1.0 ppb |
| | (C) | | | | 1.0 | 22.0 ppb |
| 02 | (A) | S | Kitchen Prep Sink - Right | | 1.0 | 135.0 ppb |
| | (B) | S | Kitchen Prep Sink - Right | | 1.0 | ppb |
| 03 | (A) | S | Pot Filler | | 1.0 | ppb |
| | (B) | S | Pot Filler | | 1.0 | ppb |
| 04 | (A) | S | Dishwashing Sink | | 1.0 | ppb |
| | (B) | S | Dishwashing Sink | | 1.0 | ppb |
| 05 | (A) | F | Café Fountain (Inactive) | | 1.0 | ppb |
| | (B) | F | Café Fountain (Inactive) | | 1.0 | ppb |
| 06 | (A) | S | Nurse Office | | 1.0 | ppb |
| | (B) | S | Nurse Office | | 1.0 | ppb |
| 07 | (A) | S | Teachers Lounge | | 1.0 | ppb |
| | (B) | S | Teachers Lounge | | 1.0 | ppb |
| 08 | (A) | S | Hallway Sink O/S Café - Left | | 1.0 | ppb |
| | (B) | S | Hallway Sink O/S Café - Left | | 1.0 | ppb |
| 09 | (A) | S | Hallway Sink O/S Café - Right | | 1.0 | ppb |
| | (B) | S | Hallway Sink O/S Café - Right | | 1.0 | ppb |
| 10 | (A) | F | Fountain O/S Café | | 1.0 | ppb |
| | (B) | F | Fountain O/S Café | | 1.0 | ppb |
| 11 | (A) | S | Hallway Sink O/S Main Office | | 1.0 | ppb |

130711230

| | | | | |
|-----|---|------------------------------|-----|-----|
| (B) | S | Hallway Sink O/S Main Office | 1.0 | ppb |
|-----|---|------------------------------|-----|-----|

##

(Continuation Sheet)

| Source | Sample ID # | Sample Type | Sample Location | Source Notes | RL * | Lead Test Result |
|--------|-------------|-------------|--|--------------|------|------------------|
| 12 | (A) | F | Fountain O/S Main Office | | 1.0 | ppb |
| | (B) | F | Fountain O/S Main Office | | 1.0 | ppb |
| 13 | (A) | F | Fountain O/S Room 21 - Left (Inactive) | | 1.0 | ppb |
| | (B) | F | Fountain O/S Room 21 - Left (Inactive) | | 1.0 | ppb |
| 14 | (A) | F | Fountain O/S Room 21 - Right (Inactive) | | - | ppb |
| | (B) | F | Fountain O/S Room 21 - Right (Inactive) | | - | ppb |
| 15 | (A) | F | Fountain O/S Room 42 | | 1.0 | ppb |
| | (B) | F | Fountain O/S Room 42 | | 1.0 | ppb |
| 16 | (A) | F | Fountain - Gym | | 1.0 | ppb |
| | (B) | F | Fountain - Gym | | 1.0 | ppb |
| 17 | (A) | | | | 1.0 | ppb |
| | (B) | | | | 1.0 | ppb |
| 18 | (A) | | | | 1.0 | ppb |
| | (B) | | | | 1.0 | ppb |
| 19 | (A) | | | | 1.0 | ppb |
| | (B) | | | | 1.0 | ppb |
| 20 | (A) | | | | 1.0 | ppb |
| | (B) | | | | 1.0 | ppb |
| 21 | (A) | | | | 1.0 | ppb |
| | (B) | | | | 1.0 | ppb |
| 22 | (A) | | | | 1.0 | ppb |
| | (B) | | | | 1.0 | ppb |
| 23 | (A) | | | | 1.0 | ppb |
| | (B) | | | | 1.0 | ppb |
| 24 | (A) | | | | 1.0 | ppb |
| | (B) | | | | 1.0 | ppb |

16011730

APPENDIX C

CREDENTIALS

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

Lead Abatement Contractor License


The person, firm or corporation whose name appears on this certificate is licensed as a Lead Abatement Contractor as set forth in the Missouri Revised Statutes 701.300-701.338 and 19 CSR 30-70.180, as long as not suspended or revoked, and is hereby authorized to engage in lead-bearing substance activities.

Issued to:

ENPAQ, LLC

**2321 Rutger Street, Unit F
St. Louis, MO 63104**

Issuance Date: **2/10/2023**
Expiration Date: **2/26/2025**
License Number: **190226-004574**

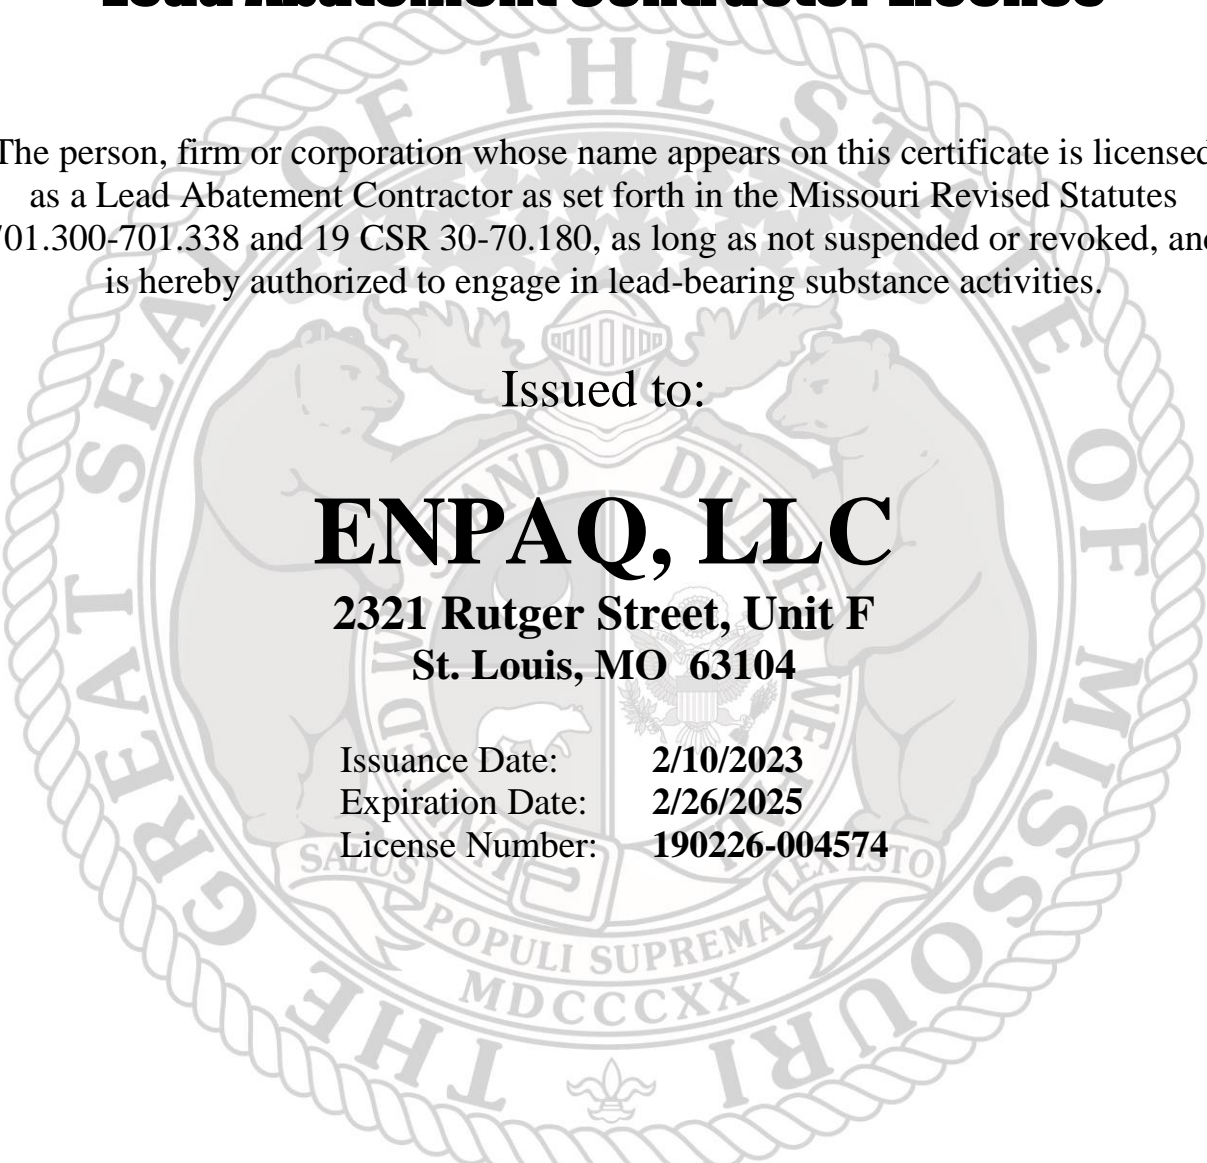

Paula F. Nickelson

Paula F. Nickelson
Acting Director
Department of Health and Senior Services

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Anthony W. Hagerty

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **10/17/2022**
Expiration Date: **10/31/2024**
License Number: **161031-300005062**



Paula F. Nickelson

Paula F. Nickelson
Acting Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

COLLEGE FOR
PUBLIC HEALTH & SOCIAL JUSTICE
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

Anthony Hagerty

3959 McDonald Ave, St. Louis, MO 63116

has attended 8 contact hours of training and successfully passed an examination

Lead Risk Assessor Refresher

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 190510

Examination Date: 3/7/2022

CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104
(314) 977-8256 slu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

Christopher C. King
Christopher C. King PhD
Director, Center for Environmental
Education and Training

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

James T. Earle

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **7/30/2022**
Expiration Date: **7/30/2024**
License Number: **180730-300005561**



Paula F. Nickelson

Paula F. Nickelson
Acting Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

COLLEGE FOR
PUBLIC HEALTH & SOCIAL JUSTICE
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

James Earle

7484 Ahern Ct., University City, MO 63130

has attended 8 contact hours of training and successfully passed an examination

Lead Risk Assessor Refresher

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117401
Examination Date: 3/7/2022
CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104
(314) 977-8256 sltu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

Christopher C. King
Christopher C. King PhD
Director, Center for Environmental
Education and Training

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Zachary A. Haselhorst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **3/1/2022**
Expiration Date: **3/1/2024**
License Number: **160229-300004899**



A handwritten signature in black ink, appearing to read "Richard W. Moore", is positioned above the printed name.

Richard W. Moore
Acting Director
Department of Health and Senior Services

COLLEGE FOR
PUBLIC HEALTH & SOCIAL JUSTICE
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

Zachary Haselhorst

209 E 5th St, Trenton, IL 62293

has attended 8 contact hours of training and successfully passed an examination

Lead Risk Assessor Refresher

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117400
Examination Date: 3/7/2022
CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104
(314) 977-8256 slu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

Christopher C. King
Christopher C. King PhD
Director, Center for Environmental
Education and Training

State of Missouri
Department of Natural Resources

Certificate of Approval
for Chemical Laboratory Service

This is to certify that

Teklab, Incorporated

is hereby approved to perform the analysis of drinking water as specified on the
Certified Parameter List, which must accompany this certificate to be valid.

Certification Number 930

Date Issued December 13, 2021

Expiration Date January 31, 2025



Laboratory Certification Authority, Public Drinking Water Branch
Missouri Department of Natural Resources



Laboratory Certification Officer, Environmental Services Program
Missouri Department of Natural Resources

MISSOURI DEPARTMENT OF NATURAL RESOURCES
DRINKING WATER LABORATORY
CERTIFIED PARAMETER LIST

This is to certify that

Teklab, Incorporated

located at

5445 Horseshoe Lake Road, Collinsville, IL 62234

has been approved to perform the indicated procedures on drinking water under the Missouri Public Drinking Water Regulations (10 CSR 60-5.020). Specific method numbers or references are included in parenthesis when appropriate.

INORGANIC

EPA 335.4

Total Cyanide

EPA 353.2

Nitrate, Nitrite, Total Nitrate and Nitrite

EPA 245.1

Mercury

EPA 200.7

Barium, Beryllium, Cadmium, Chromium, Copper, Nickel

EPA 200.8

Antimony, Arsenic, Barium, Beryllium, Cadmium, Chromium, Copper, Lead, Nickel, Selenium, Thallium

SM4500F-C

Fluoride

SM4500NO2-B

Nitrite

Teklab, Incorporated

Expiration Date: January 31, 2025

Missouri Certificate No.: 930

Original Certifying State: Illinois