

# **REPORT OF DRINKING WATER SAMPLING FOR LEAD CONTENT:**

**HAZELWOOD NORTH MIDDLE SCHOOL  
4420 VALLE AVENUE  
FLORISSANT, MO 63034**



***PREPARED FOR:***

**MR. DAVID DUDLEY  
DIRECTOR OF MAINTENANCE  
HAZELWOOD SCHOOL DISTRICT  
15875 NEW HALLS FERRY RD  
FLORISSANT, MISSOURI 63031**

***PREPARED BY:***

**ENPAQ, LLC  
3130 GRAVOIS AVENUE  
ST. LOUIS, MISSOURI 63139**

**JULY 2023**

**DOCUMENT TO BE RETAINED INDEFINITELY**

# **TABLE OF CONTENTS**

23-170

Drinking Water Sampling for Lead  
Hazelwood School District  
Hazelwood North Middle School  
4420 Valle Avenue  
Florissant, MO 63034

EXECUTIVE SUMMARY

APPENDIX A ..... Sample Locations/Results

APPENDIX B ..... Laboratory Analysis

APPENDIX C ..... Credentials

# EXECUTIVE SUMMARY

ENPAQ, LLC performed lead testing of multiple drinking fountain water sources at Hazelwood North Middle School located at 4420 Valle Avenue in Florissant, Missouri. The sampling was performed by trained and licensed personnel in accordance with USEPA, HUD, and State of Missouri Regulations and Guidelines.

All inspectors involved with sampling activities had EPA-approved training in Lead. Credentials for our firm and the inspector collecting the samples are included in Attachment C to this document.

All samples were collected on a “first draw” basis. “First draw” is achieved by allowing the water system to rest for at least eight hours prior to sampling in order to collect any existing debris or settlement within the sample. The intent of this sampling is to replicate “worst-case scenario” conditions. As such, ENPAQ inspectors met at the school to collect water samples before the systems were used by staff or students. A second sample from each water source was collected as a “follow-up” sample basis. “Follow-up” sampling is achieved by allowing the water system to run for thirty (30) seconds after the first draw sampling. The intent of this sampling is to determine if lead contamination may be in the water lines connected to the water sources and not just at the fixture. The sampling was completed in accordance with the Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* requirements. The Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* and other regulatory agencies recommend that water sources run for at least thirty seconds and as long as two minutes prior to use to avoid settling within the water system.

Drinking water samples were collected from thirty-two (32) different locations throughout Hazelwood North Middle School during the sampling event. The water samples were collected from drinking fountains utilized for drinking activities at the campus. After sample collection, samples were immediately delivered to Teklab, Inc. located in Collinsville, Illinois following strict chain of custody procedures. Teklab is a NELAP-accredited and State of Missouri-licensed laboratory specializing in drinking water analysis. Detailed sampling locations and sample results are located in Attachment A of this report.

**Any samples reported over 5.0 ppb should be re-sampled on an annual basis at a minimum.**

## CONCLUSION/RECOMMENDATIONS

At this time, ENPAQ recommends that all water sources testing at 5.0 ppb or above be removed from service. These sources are subject to additional maintenance activities and remediation prior to use. Before being put back into service, it is recommended these sources be re-tested to confirm compliance with acceptable levels.

Remediation includes decreasing lead concentrations below 5 parts per billion using methods such as replacement of plumbing, solder, fittings, or fixtures, installation of filters and filter devices, or other effective methods in accordance with Missouri SB681 *Get the Lead Out of Schools Drinking Water Act*.

In addition, all sources will be subject to an ongoing maintenance program and re-testing at appropriate intervals. **Any samples reported over 5.0 ppb should be re-sampled on an annual basis at a minimum.**

**Although no additional samples were identified above the action level, ENPAQ recommends that all water sources run for at least thirty seconds prior to use as recommended by the USEPA.**

# **APPENDIX A**

## **SAMPLE LOCATIONS & RESULTS**

**Prep Day: 7/19/23**

**Sample Day: 7/20/23**

**To Lab -----> 7/20/23**

\* Reporting Limit

# Disabled =	<b>0</b>
# of Samples =	<b>66</b>
# > 10.0 ppb =	<b>0</b>
# > 5.0 ppb =	<b>0</b>

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
01	(A)	S	Kitchen Prep Sink #1		1.0	1.6 ppb
	(B)	S	Kitchen Prep Sink #1		1.0	1.7 ppb
	(C)				1.0	N/A ppb
02	(A)	S	Kitchen Prep Sink #2		1.0	3.0 ppb
	(B)	S	Kitchen Prep Sink #2		1.0	1.9 ppb
03	(A)	S	Kitchen Prep Sink #3		1.0	2.6 ppb
	(B)	S	Kitchen Prep Sink #3		1.0	<1.0 ppb
04	(A)	S	Kitchen Prep Sink #4		1.0	1.3 ppb
	(B)	S	Kitchen Prep Sink #4		1.0	2.2 ppb
05	(A)	S	Pot Filler		1.0	2.3 ppb
	(B)	S	Pot Filler		1.0	<1.0 ppb
06	(A)	S	Dishwashing Sink- Left		1.0	<1.0 ppb
	(B)	S	Dishwashing Sink- Left		1.0	<1.0 ppb
07	(A)	S	Dishwashing Sink- Center		1.0	2.0 ppb
	(B)	S	Dishwashing Sink- Center		1.0	<1.0 ppb
08	(A)	S	Dishwashing Sink- Right		1.0	<1.0 ppb
	(B)	S	Dishwashing Sink- Right		1.0	<1.0 ppb
09	(A)	F	Café Fountain		1.0	<1.0 ppb
	(B)	F	Café Fountain		1.0	<1.0 ppb
10	(A)	F	Gym Fountain- Left		1.0	<1.0 ppb
	(B)	F	Gym Fountain- Left		1.0	<1.0 ppb
11	(A)	F	Gym Fountain- Right		1.0	<1.0 ppb
	(B)	F	Gym Fountain- Right		1.0	<1.0 ppb

## (Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
12	(A)	F	Band Hallway Fountain- Left		1.0	<1.0 ppb
	(B)	F	Band Hallway Fountain- Left		1.0	<1.0 ppb
13	(A)	F	Band Hallway Fountain- Right		1.0	<1.0 ppb
	(B)	F	Band Hallway Fountain- Right		1.0	<1.0 ppb
14	(A)	S	Nurse Office Sink		1.0	<1.0 ppb
	(B)	S	Nurse Office Sink		1.0	<1.0 ppb
15	(A)	F	Fountain O/S Room 126- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 126- Left		1.0	<1.0 ppb
16	(A)	F	Fountain O/S Room 126- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 126- Right		1.0	<1.0 ppb
17	(A)	F	Fountain O/S Room 101- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 101- Left		1.0	<1.0 ppb
18	(A)	F	Fountain O/S Room 101- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 101- Right		1.0	<1.0 ppb
19	(A)	S	Room 101 Sink		1.0	<1.0 ppb
	(B)	S	Room 101 Sink		1.0	<1.0 ppb
20	(A)	S	Room 201 Sink		1.0	<1.0 ppb
	(B)	S	Room 201 Sink		1.0	<1.0 ppb
21	(A)	F	Fountain O/S Room 201- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 201- Left		1.0	<1.0 ppb
22	(A)	F	Fountain O/S Room 201- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 201- Right		1.0	<1.0 ppb
23	(A)	F	Fountain O/S Room 221- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 221- Left		1.0	<1.0 ppb
24	(A)	F	Fountain O/S Room 221- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 221- Right		1.0	<1.0 ppb
25	(A)	S	Teachers Lounge 221		1.0	<1.0 ppb
	(B)	S	Teachers Lounge 221		1.0	<1.0 ppb

## (Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
26	(A)	F	Fountain O/S Room 321- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 321- Left		1.0	<1.0 ppb
27	(A)	F	Fountain O/S Room 321- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 321- Right		1.0	<1.0 ppb
28	(A)	S	Room 321- Left		1.0	<1.0 ppb
	(B)	S	Room 321- Left		1.0	<1.0 ppb
29	(A)	S	Room 321- Right		1.0	<1.0 ppb
	(B)	S	Room 321- Right		1.0	<1.0 ppb
30	(A)	F	Fountain O/S Room 301- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 301- Left		1.0	<1.0 ppb
31	(A)	F	Fountain O/S Room 301- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 301- Right		1.0	<1.0 ppb
32	(A)	S	Room 301		1.0	1.9 ppb
	(B)	S	Room 301		1.0	<1.0 ppb

**Sample ID Coding Key:**

F = Fountain


S = Sink

(A) = 1st Sample


(B) = 2nd Sample (30 Seconds Later)

(C) = 3rd Sample (3 Minutes Later)



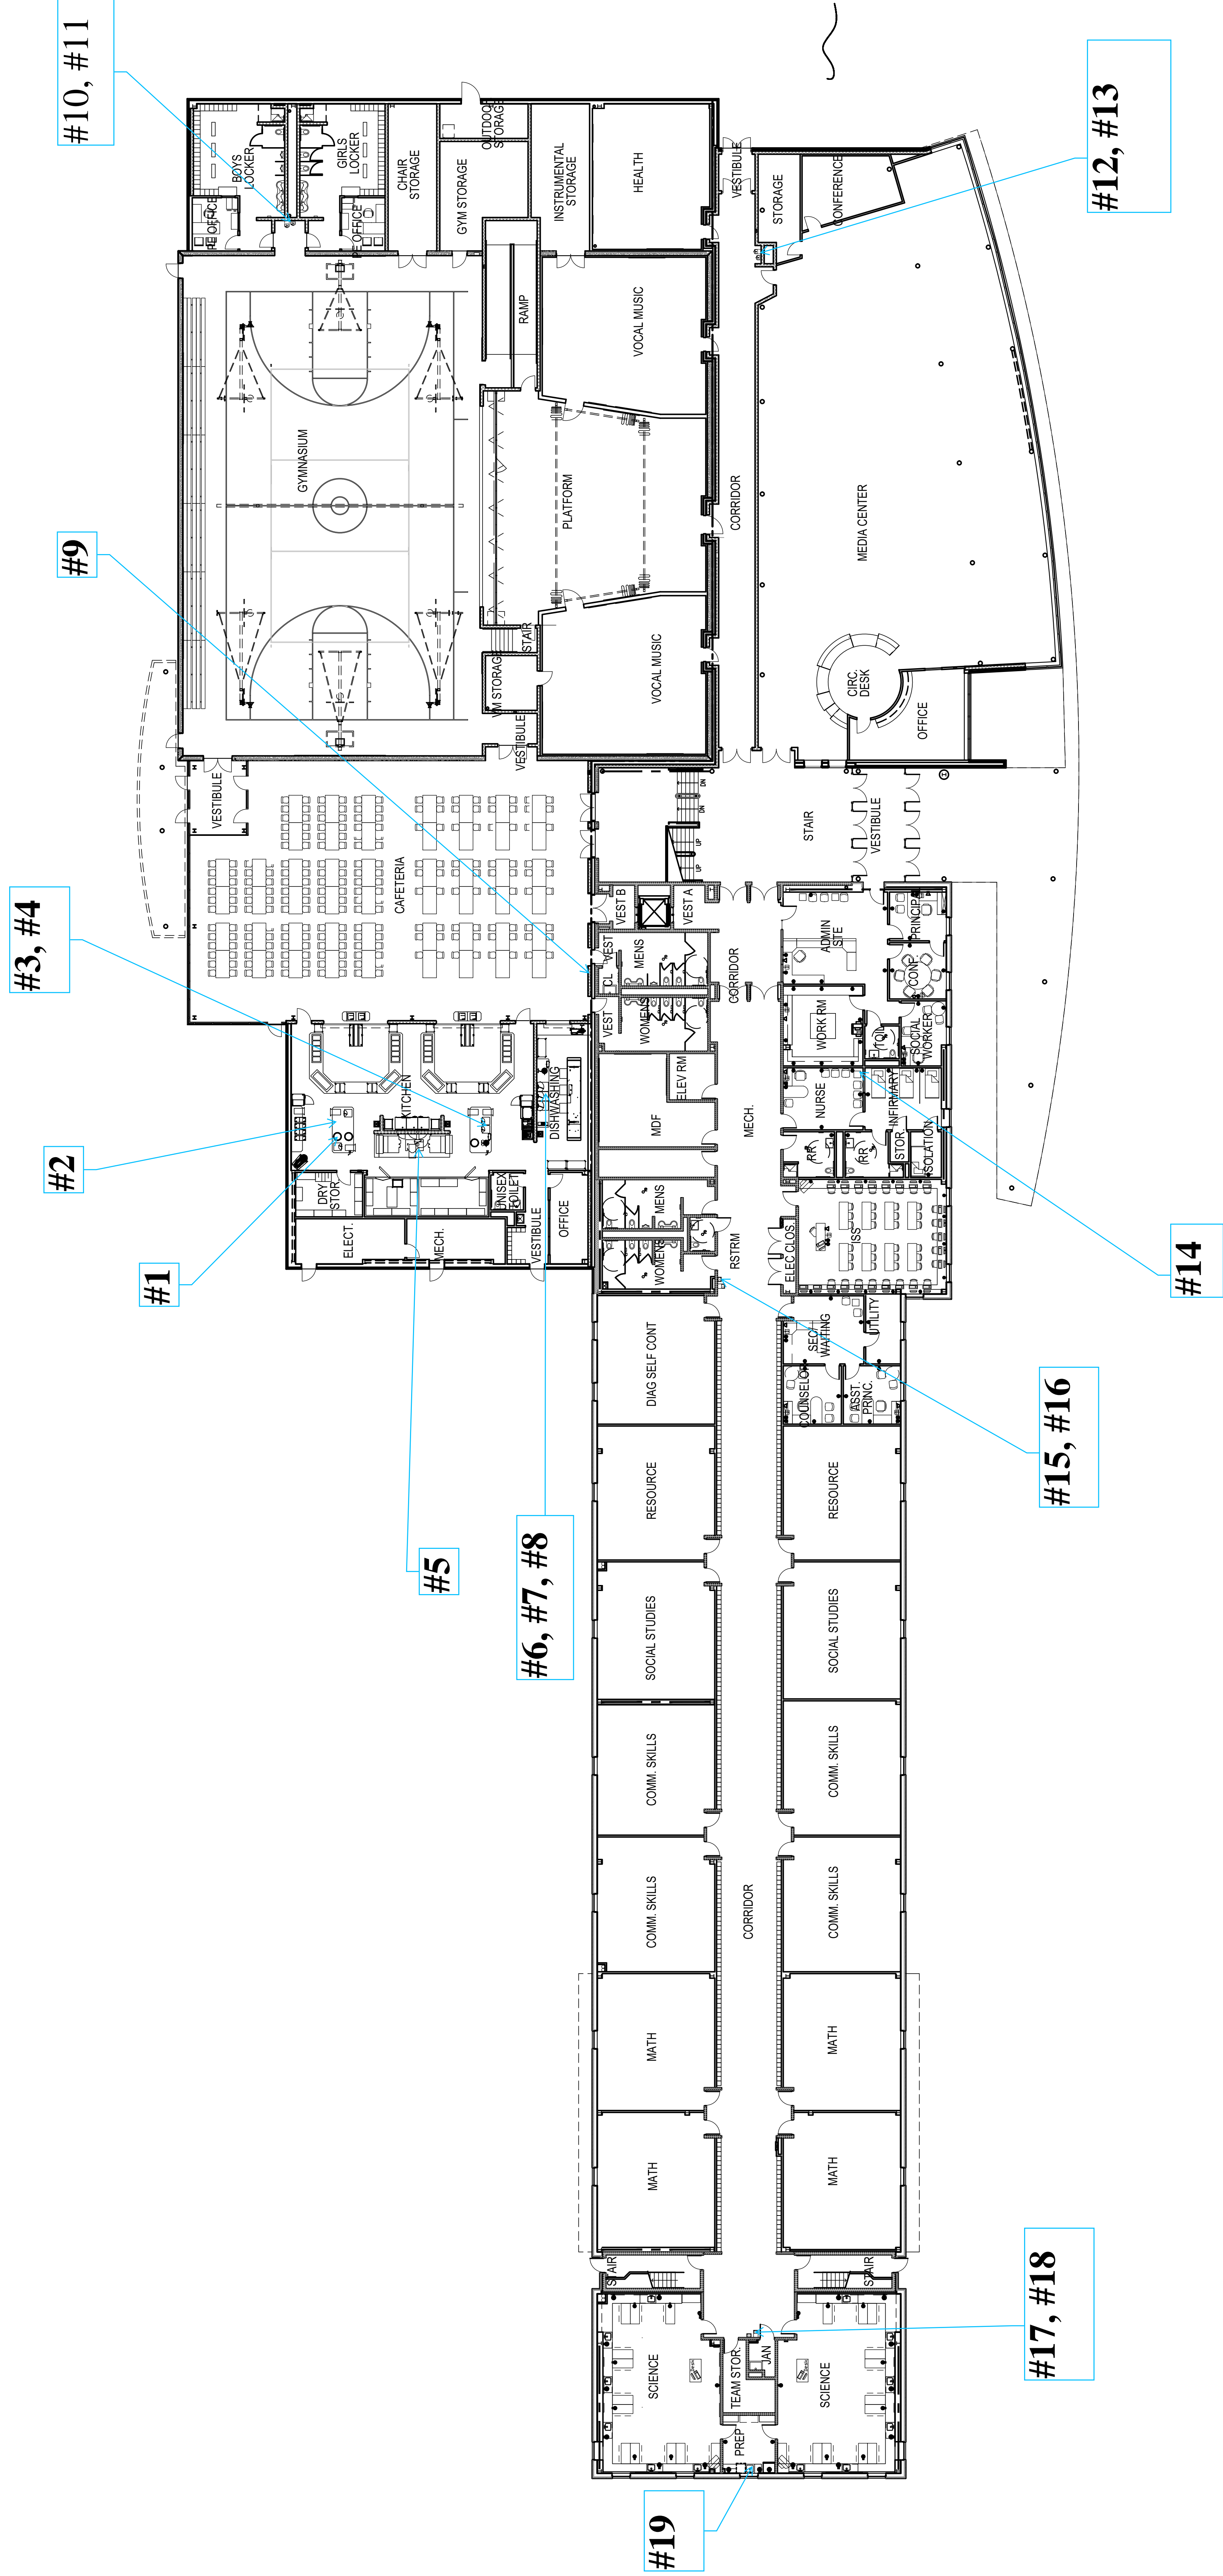


1ST FLOOR PLAN

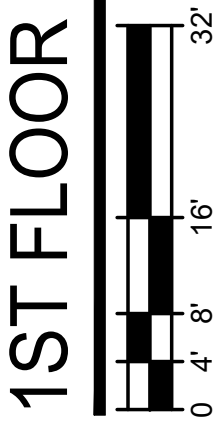


## NORTH MIDDLE SCHOOL

HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI  
21-100  
03-09-2021

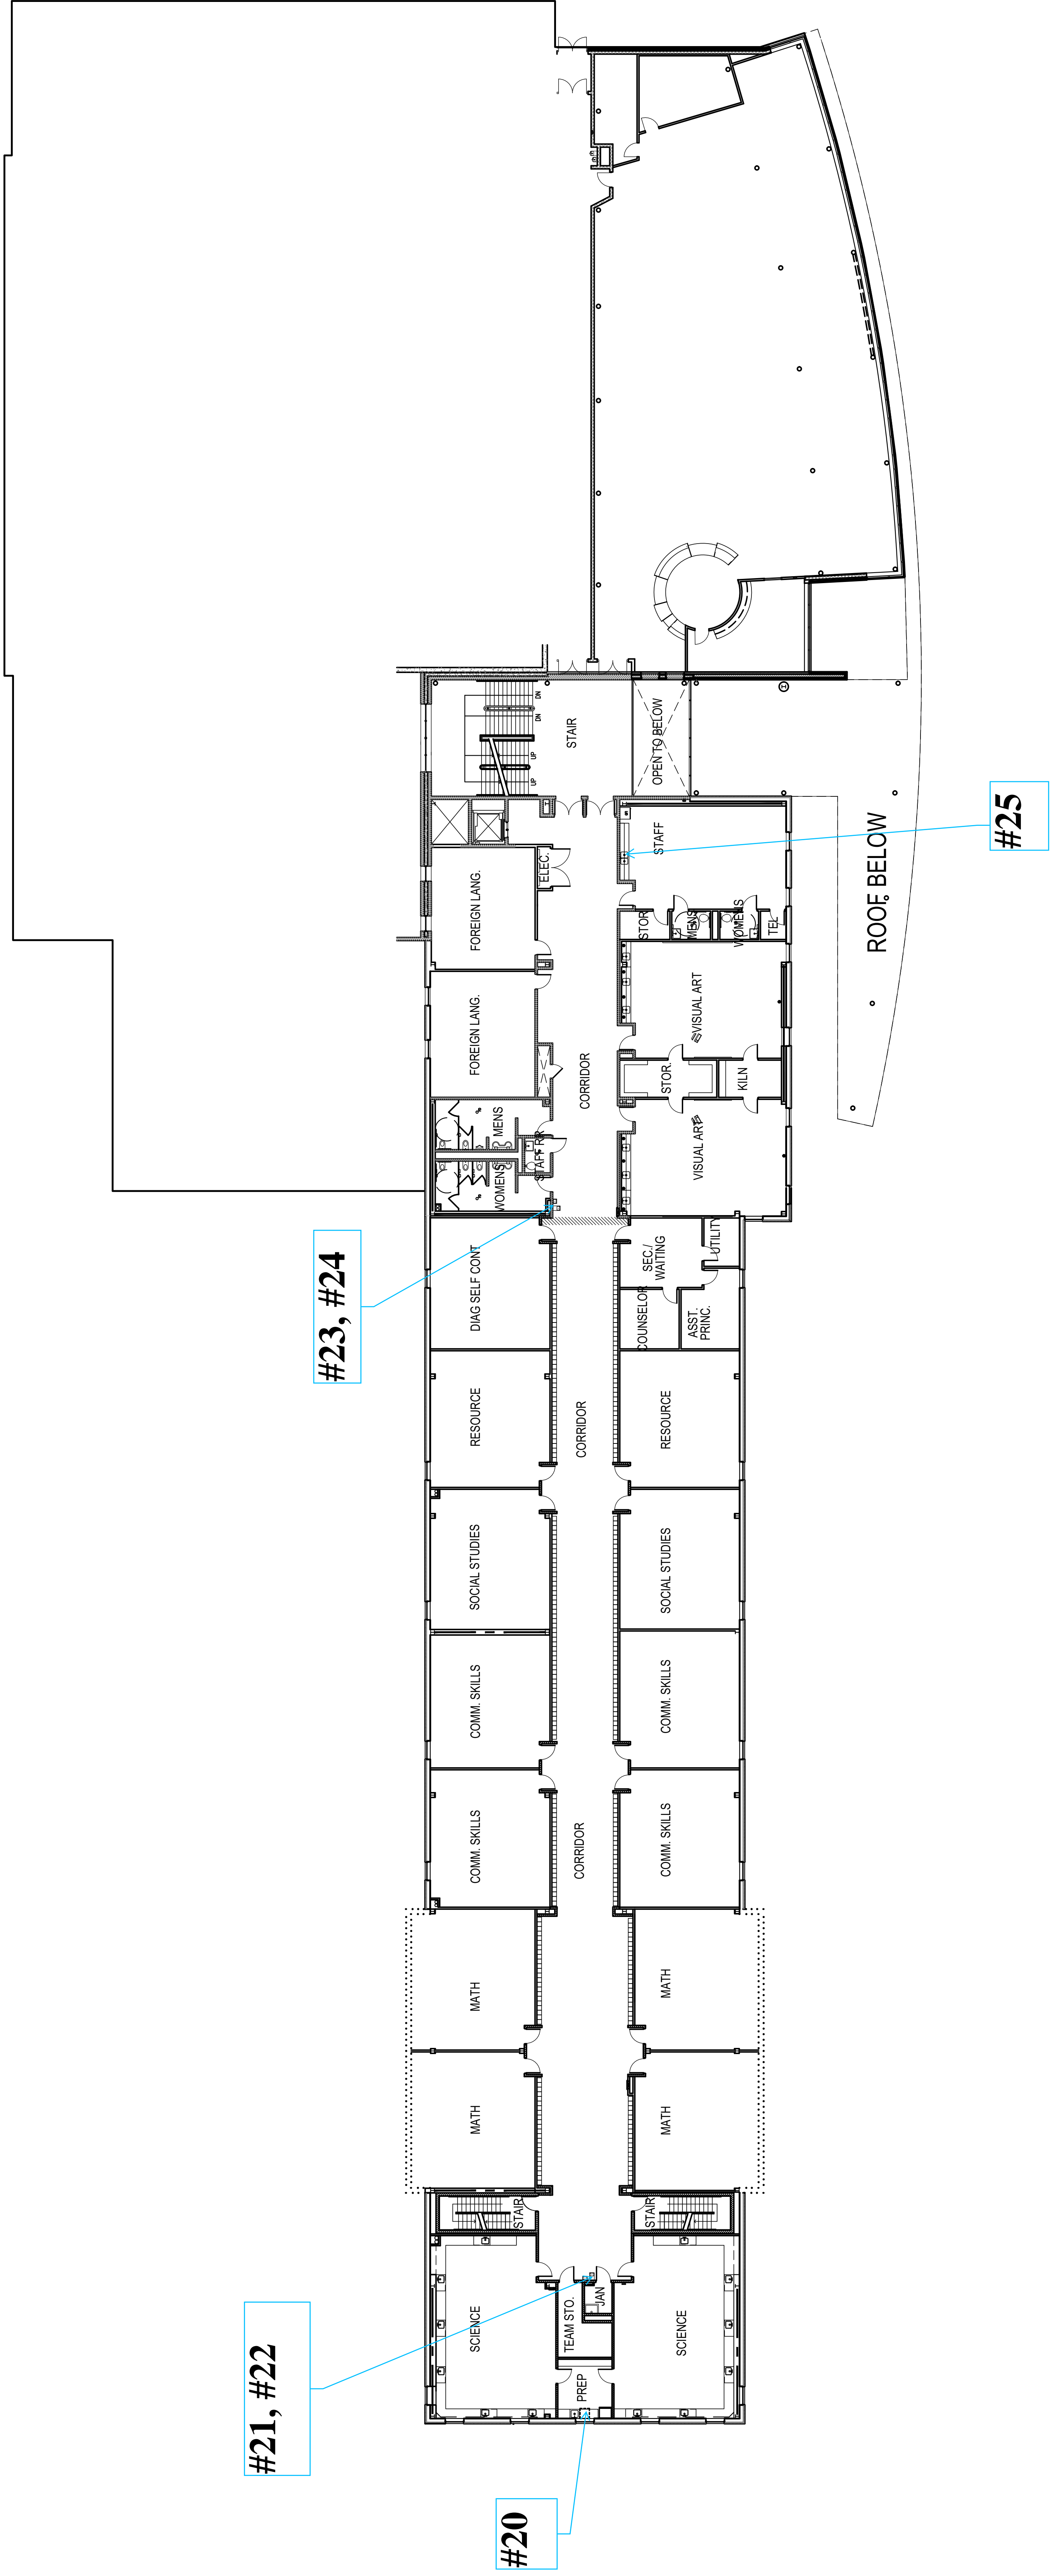


2ND FLOOR PLAN

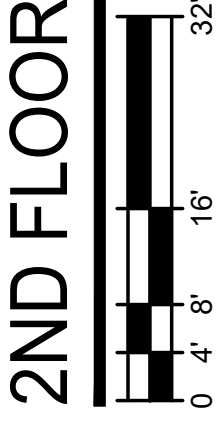

# NORTH MIDDLE SCHOOL

HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI  
21-100  
03-09-2021



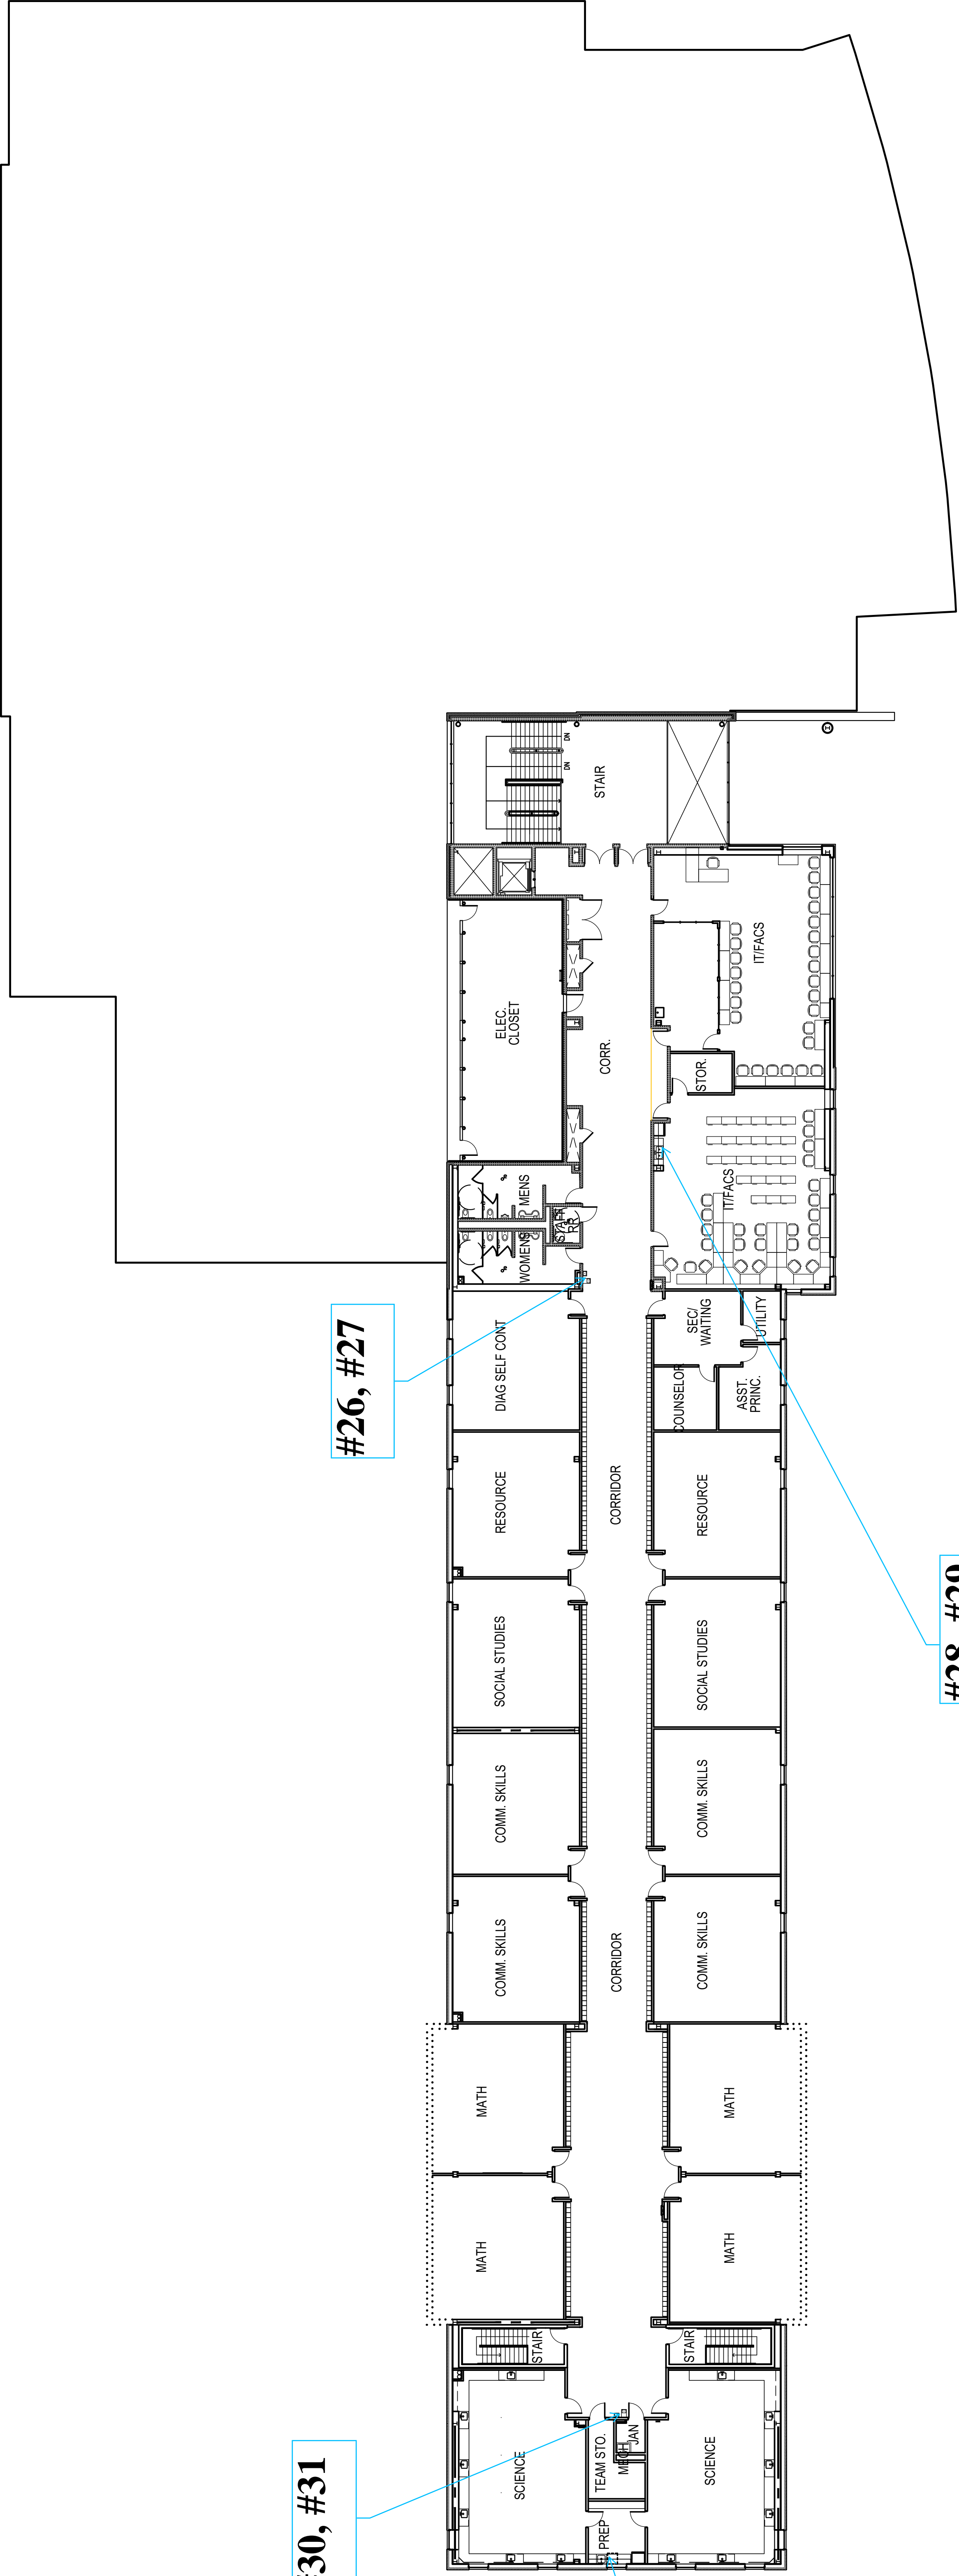


#30, #31

#26, #27

#32

#28, #29

3RD FLOOR PLAN

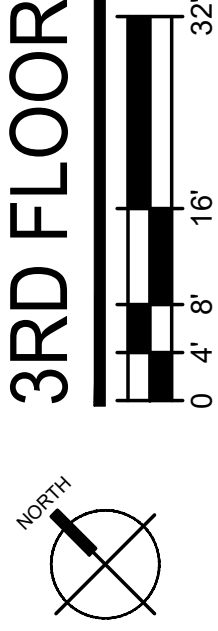

# NORTH MIDDLE SCHOOL

HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI  
21-100  
03-09-2021

## **APPENDIX B**

### **LABORATORY ANALYSIS**

August 25, 2023

Tony Hagerty  
ENPAQ, LLC  
3130 Gravois Ave  
St. Louis, MO 63118  
TEL: (314) 449-1976  
FAX:



Illinois	100226
Kansas	E-10374
Louisiana	05002
Louisiana	05003
Oklahoma	9978

**RE:** Hazelwood SD/ 23-170 Hazelwood North Middle

**WorkOrder:** 23071463

Dear Tony Hagerty:

TEKLAB, INC received 66 samples on 7/20/2023 3:24:00 PM for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Marvin L. Darling  
Project Manager  
(618)344-1004 ex 41  
[mdarling@teklabinc.com](mailto:mdarling@teklabinc.com)



## Report Contents

<http://www.teklabinc.com/>

**Client:** ENPAQ, LLC

**Work Order:** 23071463

**Client Project:** Hazelwood SD/ 23-170 Hazelwood North Middle

**Report Date:** 25-Aug-23

**This reporting package includes the following:**

Cover Letter	1
Report Contents	2
Definitions	3
Case Narrative	5
Accreditations	6
Laboratory Results	7
Receiving Check List	9
Chain of Custody	Appended

**Client:** ENPAQ, LLC**Work Order:** 23071463**Client Project:** Hazelwood SD/ 23-170 Hazelwood North Middle**Report Date:** 25-Aug-23**Abbr Definition**

\* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count ( > 200 CFU )

**Client:** ENPAQ, LLC

**Work Order:** 23071463

**Client Project:** Hazelwood SD/ 23-170 Hazelwood North Middle

**Report Date:** 25-Aug-23

### Qualifiers

- |   |  |
|---|--|
| # - Unknown hydrocarbon                               | B - Analyte detected in associated Method Blank              |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range                           |
| H - Holding times exceeded                            | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits        | M - Manual Integration used to determine area response       |
| ND - Not Detected at the Reporting Limit              | R - RPD outside accepted recovery limits                     |
| S - Spike Recovery outside recovery limits            | T - TIC(Tentatively identified compound)                     |
| X - Value exceeds Maximum Contaminant Level           |  |





## Case Narrative

<http://www.teklabinc.com/>

**Client:** ENPAQ, LLC

**Work Order:** 23071463

**Client Project:** Hazelwood SD/ 23-170 Hazelwood North Middle

**Report Date:** 25-Aug-23

**Cooler Receipt Temp:** NA °C

### Locations

#### Collinsville

**Address** 5445 Horseshoe Lake Road  
Collinsville, IL 62234-7425  
**Phone** (618) 344-1004  
**Fax** (618) 344-1005  
**Email** jhriley@teklabinc.com

#### Collinsville Air

**Address** 5445 Horseshoe Lake Road  
Collinsville, IL 62234-7425  
**Phone** (618) 344-1004  
**Fax** (618) 344-1005  
**Email** EHurley@teklabinc.com

#### Springfield

**Address** 3920 Pintail Dr  
Springfield, IL 62711-9415  
**Phone** (217) 698-1004  
**Fax** (217) 698-1005  
**Email** KKlostermann@teklabinc.com

#### Chicago

**Address** 1319 Butterfield Rd.  
Downers Grove, IL 60515  
**Phone** (630) 324-6855  
**Fax**  
**Email** arenner@teklabinc.com

#### Kansas City

**Address** 8421 Nieman Road  
Lenexa, KS 66214  
**Phone** (913) 541-1998  
**Fax** (913) 541-1998  
**Email** jhriley@teklabinc.com

**Client:** ENPAQ, LLC**Work Order:** 23071463**Client Project:** Hazelwood SD/ 23-170 Hazelwood North Middle**Report Date:** 25-Aug-23

State	Dept	Cert #	NELAP	Exp Date	Lab
Illinois	IEPA	100226	NELAP	1/31/2024	Collinsville
Kansas	KDHE	E-10374	NELAP	4/30/2024	Collinsville
Louisiana	LDEQ	05002	NELAP	6/30/2024	Collinsville
Louisiana	LDEQ	05003	NELAP	6/30/2024	Collinsville
Oklahoma	ODEQ	9978	NELAP	8/31/2023	Collinsville
Arkansas	ADEQ	88-0966		3/14/2024	Collinsville
Illinois	IDPH	17584		5/31/2025	Collinsville
Iowa	IDNR	430		6/1/2024	Collinsville
Kentucky	UST	0073		1/31/2024	Collinsville
Missouri	MDNR	00930		5/31/2023	Collinsville
Missouri	MDNR	930		1/31/2025	Collinsville



## Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071463

Client Project: Hazelwood SD/ 23-170 Hazelwood North Middle

Report Date: 25-Aug-23

Matrix: DRINKING WATER

Sample ID	Client Sample ID	Certification	Qual	RL	Result	Units	DF	Date Analyzed	Date Collected
<b>EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)</b>									
<b>Lead</b>									
23071463-001A	01A	NELAP		1.0	1.6	µg/L	1	08/15/2023 18:28	07/20/2023 0:00
23071463-002A	01B	NELAP		1.0	1.7	µg/L	1	08/15/2023 18:33	07/20/2023 0:00
23071463-003A	02A	NELAP		1.0	3.0	µg/L	1	08/15/2023 18:37	07/20/2023 0:00
23071463-004A	02B	NELAP		1.0	1.9	µg/L	1	08/21/2023 3:26	07/20/2023 0:00
23071463-005A	03A	NELAP		1.0	2.6	µg/L	1	08/15/2023 19:14	07/20/2023 0:00
23071463-006A	03B	NELAP		1.0	< 1.0	µg/L	1	08/15/2023 19:18	07/20/2023 0:00
23071463-007A	04A	NELAP		1.0	1.3	µg/L	1	08/15/2023 19:22	07/20/2023 0:00
23071463-008A	04B	NELAP		1.0	2.2	µg/L	1	08/15/2023 19:26	07/20/2023 0:00
23071463-009A	05A	NELAP		1.0	2.3	µg/L	1	08/07/2023 18:25	07/20/2023 0:00
23071463-010A	05B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 18:29	07/20/2023 0:00
23071463-011A	06A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 18:56	07/20/2023 0:00
23071463-012A	06B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 18:34	07/20/2023 0:00
23071463-013A	07A	NELAP		1.0	2.0	µg/L	1	08/07/2023 18:38	07/20/2023 0:00
23071463-014A	07B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 18:42	07/20/2023 0:00
23071463-015A	08A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 18:47	07/20/2023 0:00
23071463-016A	08B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 18:51	07/20/2023 0:00
23071463-017A	09A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 19:32	07/20/2023 0:00
23071463-018A	09B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 19:36	07/20/2023 0:00
23071463-019A	10A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 19:41	07/20/2023 0:00
23071463-020A	10B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 19:45	07/20/2023 0:00
23071463-021A	11A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 19:50	07/20/2023 0:00
23071463-022A	11B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 19:54	07/20/2023 0:00
23071463-023A	12A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 20:03	07/20/2023 0:00
23071463-024A	12B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 19:59	07/20/2023 0:00
23071463-025A	13A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 20:30	07/20/2023 0:00
23071463-026A	13B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 20:34	07/20/2023 0:00
23071463-027A	14A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 20:39	07/20/2023 0:00
23071463-028A	14B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 20:43	07/20/2023 0:00
23071463-029A	15A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 20:48	07/20/2023 0:00
23071463-030A	15B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 20:52	07/20/2023 0:00
23071463-031A	16A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 20:57	07/20/2023 0:00
23071463-032A	16B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 21:28	07/20/2023 0:00
23071463-033A	17A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 21:33	07/20/2023 0:00
23071463-034A	17B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 21:01	07/20/2023 0:00
23071463-035A	18A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 21:37	07/20/2023 0:00
23071463-036A	18B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 21:42	07/20/2023 0:00
23071463-037A	19A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 21:46	07/20/2023 0:00
23071463-038A	19B	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 21:51	07/20/2023 0:00
23071463-039A	20A	NELAP		1.0	< 1.0	µg/L	1	08/10/2023 22:30	07/20/2023 0:00
23071463-040A	20B	NELAP		1.0	< 1.0	µg/L	1	08/10/2023 22:35	07/20/2023 0:00
23071463-041A	21A	NELAP		1.0	< 1.0	µg/L	1	08/10/2023 22:39	07/20/2023 0:00
23071463-042A	21B	NELAP		1.0	< 1.0	µg/L	1	08/10/2023 22:44	07/20/2023 0:00
23071463-043A	22A	NELAP		1.0	< 1.0	µg/L	1	08/07/2023 21:59	07/20/2023 0:00
23071463-044A	22B	NELAP		1.0	< 1.0	µg/L	1	08/10/2023 22:48	07/20/2023 0:00
23071463-045A	23A	NELAP		1.0	< 1.0	µg/L	1	08/10/2023 22:53	07/20/2023 0:00
23071463-046A	23B	NELAP		1.0	< 1.0	µg/L	1	08/10/2023 22:57	07/20/2023 0:00
23071463-047A	24A	NELAP		1.0	< 1.0	µg/L	1	08/10/2023 23:02	07/20/2023 0:00
23071463-048A	24B	NELAP		1.0	< 1.0	µg/L	1	08/24/2023 13:55	07/20/2023 0:00



## Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071463

Client Project: Hazelwood SD/ 23-170 Hazelwood North Middle

Report Date: 25-Aug-23

Matrix: DRINKING WATER

Sample ID	Client Sample ID	Certification	Qual	RL	Result	Units	DF	Date Analyzed	Date Collected
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)									
Lead									
23071463-049A	25A	NELAP		1.0	< 1.0	µg/L	1	08/21/2023 3:21	07/20/2023 0:00
23071463-050A	25B	NELAP		1.0	< 1.0	µg/L	1	08/15/2023 20:12	07/20/2023 0:00
23071463-051A	26A	NELAP		1.0	< 1.0	µg/L	1	08/15/2023 20:16	07/20/2023 0:00
23071463-052A	26B	NELAP		1.0	< 1.0	µg/L	1	08/21/2023 3:49	07/20/2023 0:00
23071463-053A	27A	NELAP		1.0	< 1.0	µg/L	1	08/15/2023 20:20	07/20/2023 0:00
23071463-054A	27B	NELAP		1.0	< 1.0	µg/L	1	08/15/2023 20:24	07/20/2023 0:00
23071463-055A	28A	NELAP		1.0	< 1.0	µg/L	1	08/21/2023 4:23	07/20/2023 0:00
23071463-056A	28B	NELAP		1.0	< 1.0	µg/L	1	08/21/2023 4:29	07/20/2023 0:00
23071463-057A	29A	NELAP		1.0	< 1.0	µg/L	1	08/15/2023 20:36	07/20/2023 0:00
23071463-058A	29B	NELAP		1.0	< 1.0	µg/L	1	08/15/2023 20:40	07/20/2023 0:00
23071463-059A	30A	NELAP		1.0	< 1.0	µg/L	1	08/15/2023 20:44	07/20/2023 0:00
23071463-060A	30B	NELAP		1.0	< 1.0	µg/L	1	08/21/2023 4:35	07/20/2023 0:00
23071463-061A	31A	NELAP		1.0	< 1.0	µg/L	1	08/15/2023 21:05	07/20/2023 0:00
23071463-062A	31B	NELAP		1.0	< 1.0	µg/L	1	08/11/2023 2:46	07/20/2023 0:00
23071463-063A	32A	NELAP		1.0	1.9	µg/L	1	08/11/2023 2:15	07/20/2023 0:00
23071463-064A	32B	NELAP		1.0	< 1.0	µg/L	1	08/11/2023 2:19	07/20/2023 0:00



## Receiving Check List

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071463

Client Project: Hazelwood SD/ 23-170 Hazelwood North Middle

Report Date: 25-Aug-23

Carrier: James Earle

Received By: MBP

Completed by:

Reviewed by:

On:

On:

21-Jul-23

21-Jul-23

Ellie Hopkins

Elizabeth A. Hurley

Pages to follow: Chain of custody

Extra pages included

Shipping container/cooler in good condition?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	Not Present <input type="checkbox"/>	Temp °C <b>NA</b>
Type of thermal preservation?	None <input checked="" type="checkbox"/>	Ice <input type="checkbox"/>	Blue Ice <input type="checkbox"/>	Dry Ice <input type="checkbox"/>
Chain of custody present?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Chain of custody signed when relinquished and received?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Chain of custody agrees with sample labels?	Yes <input type="checkbox"/>	No <input checked="" type="checkbox"/>		
Samples in proper container/bottle?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Sample containers intact?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Sufficient sample volume for indicated test?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
All samples received within holding time?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Reported field parameters measured:	Field <input type="checkbox"/>	Lab <input type="checkbox"/>	NA <input checked="" type="checkbox"/>	
Container/Temp Blank temperature in compliance?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		

When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.

Water – at least one vial per sample has zero headspace?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	No VOA vials <input checked="" type="checkbox"/>
Water - TOX containers have zero headspace?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	No TOX containers <input checked="" type="checkbox"/>
Water - pH acceptable upon receipt?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	NA <input type="checkbox"/>
NPDES/CWA TCN interferences checked/treated in the field?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>

Any No responses must be detailed below or on the COC.

Samples were checked for turbidity and then preserved with nitric acid upon arrival in the laboratory.

Samples 33A and 33B were not received. - LM/ERH 7/21/23

Pg \_\_\_ of \_\_\_ Workorder # 23071463

Client: ENPAQ, LLC  
Address: 3130 Gravois Ave.  
City/State/Zip: Collinsville, IL 62234  
Contact: Anthony Hagerty Phone: (314) 449-1976  
Email: tony.hagerty@enpaqconsulting.com Fax: \_\_\_\_\_

Samples on: ☐ ICE ☐ BLUE ICE ☒ NO ICE NA °C  
Preserved in: ☒ LAB ☐ FIELD FOR LAB USE ONLY  
LAB NOTES:

**Client Comments:** Hazelwood North Middle School  
Please Report in PPB

Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No

Are these samples known to be hazardous? ☐ Yes ☒ No

Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No

PROJECT NAME/NUMBER

Hazelwood SD/ 23-170

**SAMPLE COLLECTOR'S NAME**

J. Ewer

### RESULTS REQUESTED

☒ Standard
 ☐ 1-2 Day (100% Surcharge)
 ☐ Other
 ☐ 3 Day (50% Surcharge)

## BILLING INSTRUCTIONS

Lab Use Only	Sample ID	Date/Time Sampled	Matrix
23071403-001	01 A	7/20/23	Aqueous
-002	01 B		Aqueous
-003	02 A		Aqueous
-004	02 B		Aqueous
-005	03 A		Aqueous
-006	03 B		Aqueous
-007	04 A		Aqueous
-008	04 B		Aqueous
-009	05 A		Aqueous
-010	05 B		Aqueous
			Aqueous

## Relinquished By

Date/Time

Received By

Date/Time

7120123

Морзе Ретт

7/20/23 1524

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions

Pg \_\_\_ of \_\_\_ Workorder # 23071463

Client: ENPAQ, LLC  
Address: 3130 Gravois Ave.  
City/State/Zip: Collinsville, IL 62234  
Contact: Anthony Hagerty Phone: (314) 449-1976  
Email: tony.hagerty@enpaqconsulting.com Fax: \_\_\_\_\_

Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE \_\_\_\_\_ °C  
Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY

**LAB NOTES:**

**Client Comments:** Hazelwood North Middle School  
Please Report in PPB

Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No

Are these samples known to be hazardous? ☐ Yes ☒ No

Are there any required reporting limits to be met on the requested analysis? If yes, please provide limits in the comment section: ☒ Yes ☐ No

SAMPLE COLLECTOR'S NAME

Hazelwood SD/ 23-170

J. E. L.

## BILLING INSTRUCTIONS

☒ Standard
 ☐ 1-2 Day (100% Surcharge)
 ☐ Other
 ☐ 3 Day (50% Surcharge)

# and Type of Containers	INDICATE ANALYSIS REQUESTED
Other	
TSP	
NaHSO <sub>4</sub>	
MeOH	
HCL	
H <sub>2</sub> SO <sub>4</sub>	
NaOH	
HNO <sub>3</sub>	
UNP	X

Lab Use Only	Sample ID	Date/Time Sampled	Matrix
23071403 -011	06 A	7/20/23	Aqueous
-012	06 B		Aqueous
-013	07 A		Aqueous
-014	07 B		Aqueous
-015	08 A		Aqueous
-016	08 B		Aqueous
-017	09 A		Aqueous
-018	09 B		Aqueous
-019	10 A		Aqueous
-020	10 B		Aqueous
			Aqueous

## Relinquished By

Date/Time

Received By

Date/Time

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions

Pg \_\_\_ of \_\_\_ Workorder # 23071463

Client: ENPAQ, LLC  
Address: 3130 Gravois Ave.  
City/State/Zip: Collinsville, IL 62234  
Contact: Anthony Hagerty Phone: (314) 449-1976  
Email: tony.hagerty@enpaqconsulting.com Fax: \_\_\_\_\_

Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE \_\_\_\_\_ °C  
Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY

**Client Comments:** Hazelwood North Middle School  
Please Report in PPB

Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No

Are these samples known to be hazardous? ☐ Yes ☒ No

Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No

SAMPLE COLLECTOR'S NAME

Hazelwood SD/ 23-170

J. Earle

## BILLING INSTRUCTIONS

☒ Standard
 ☐ 1-2 Day (100% Surcharge)
 ☐ Other
 ☐ 3 Day (50% Surcharge)

Lab Use Only	Sample ID	Date/Time Sampled	Matrix
23071403 -021	11A	7/26/23	Aqueous
-022	11B		Aqueous
-023	12A		Aqueous
-024	12B		Aqueous
-025	13A		Aqueous
-026	13B		Aqueous
-027	14A		Aqueous
-028	14B		Aqueous
-029	15A		Aqueous
-030	15B		Aqueous
			Aqueous

### # and Type of Containers

**INDICATE ANALYSIS REQUESTED**

[illegible]

## Relinquished By

Date/Time

Received By

Date/Time

7/20/23

Mouzen Peith

7/20/23	574
---------	-----

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions



## CHAIN OF CUSTODY

Pg \_\_\_ of \_\_\_ Workorder # 23071463

TEKLAB INC. 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Client: <u>ENPAQ, LLC</u>				Samples on: <input type="checkbox"/> ICE <input type="checkbox"/> BLUE ICE <input type="checkbox"/> NO ICE <u>      </u> °C											
Address: <u>3130 Gravois Ave.</u>				Preserved in: <input type="checkbox"/> LAB <input type="checkbox"/> FIELD <u>      </u> FOR LAB USE ONLY											
City/State/Zip: <u>Collinsville, IL 62234</u>				LAB NOTES:											
Contact: <u>Anthony Hagerty</u> Phone: <u>(314) 449-1976</u>				Client Comments: <u>Hazelwood North Middle School</u>											
Email: <u>tony.hagerty@enpaqconsulting.com</u> Fax: <u>      </u>				Please Report in PPB											
Are these samples known to be involved in litigation? If yes, a surcharge will apply: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No															
Are these samples known to be hazardous? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No															
Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No															
PROJECT NAME/NUMBER				SAMPLE COLLECTOR'S NAME				# and Type of Containers				INDICATE ANALYSIS REQUESTED			
<u>Hazelwood SD/ 23-170</u>				<u>J. Eub</u>											
RESULTS REQUESTED				BILLING INSTRUCTIONS											
<input checked="" type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge)															
<input type="checkbox"/> Other <u>      </u> <input type="checkbox"/> 3 Day (50% Surcharge)															
Lab Use Only		Sample ID		Date/Time Sampled		Matrix									
<u>23071403-031</u>		<u>16 A</u>		<u>7/20/23</u>		<u>Aqueous</u>		<u>X</u>							
<u>-032</u>		<u>16 B</u>				<u>Aqueous</u>		<u>1</u>							
<u>-033</u>		<u>17 A</u>				<u>Aqueous</u>									
<u>-034</u>		<u>17 B</u>				<u>Aqueous</u>									
<u>-035</u>		<u>18 A</u>				<u>Aqueous</u>									
<u>-036</u>		<u>18 B</u>				<u>Aqueous</u>									
<u>-037</u>		<u>14 A</u>				<u>Aqueous</u>									
<u>-038</u>		<u>14 B</u>				<u>Aqueous</u>									
<u>-039</u>		<u>20 A</u>				<u>Aqueous</u>									
<u>-040</u>		<u>20 B</u>				<u>Aqueous</u>									
						<u>Aqueous</u>									
Relinquished By <u>[Signature]</u>				Date/Time <u>7/20/23</u>				Received By <u>[Signature]</u>				Date/Time <u>7/20/23 1524</u>			

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions

Pg \_\_\_ of \_\_\_ Workorder # 23071463

Client: ENPAQ, LLC  
Address: 3130 Gravois Ave.  
City/State/Zip: Collinsville, IL 62234  
Contact: Anthony Hagerty Phone: (314) 449-1976  
Email: tony.hagerty@enpaqconsulting.com Fax: \_\_\_\_\_

**Client Comments:** Hazelwood North Middle School  
Please Report in PPB

J. En

Lab Use Only	Sample ID	Date/Time Sampled	Matrix
235714V3-041	21 A	7/20/23	Aqueous
-042	21 B		Aqueous
-043	22 A		Aqueous
-044	22 B		Aqueous
-045	23 A		Aqueous
-046	23 B		Aqueous
-047	24 A		Aqueous
-048	24 B		Aqueous
-049	25 A		Aqueous
-50	25 B		Aqueous
			Aqueous

[illegible]

Date/Time

*[Handwritten signature]*

7/20/24

Mouyzer Patti

7/24/23	1524
---------	------

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions

Pg \_\_\_\_ of \_\_\_\_ Workorder # 23071463

Client: ENPAQ, LLC  
Address: 3130 Gravois Ave.  
City/State/Zip: Collinsville, IL 62234  
Contact: Anthony Hagerty Phone: (314) 449-1976  
Email: tony.hagerty@enpaqconsulting.com Fax: \_\_\_\_\_

Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE \_\_\_\_\_ °C  
Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY  
LAB NOTES:

**Client Comments:** Hazelwood North Middle School  
Please Report in PPB

Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No

Are these samples known to be hazardous? ☐ Yes ☒ No

Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No

PROJECT NAME/NUMBER

**SAMPLE COLLECTOR'S NAME**

Hazelwood SD/ 23-170

## BILLING INSTRUCTIONS

## RESULTS REQUESTED

☒ Standard
 ☐ 1-2 Day (100% Surcharge)
 ☐ Other
 ☐ 3 Day (50% Surcharge)

Lab Use Only	Sample ID	Date/Time Sampled	Matrix
23071903 -051	26 A	7/26/23	Aqueous
-052	26 B		Aqueous
-053	27 A		Aqueous
-054	27 B		Aqueous
-055	28 A		Aqueous
-056	28 B		Aqueous
-057	29 A		Aqueous
-058	29 B		Aqueous
-059	30 A		Aqueous
-060	30 B		Aqueous
			Aqueous

### # and Type of Containers

INDICATE ANALYSIS REQUESTED

[illegible]

## Relinquished By

Date/Time

Received By

Date/Time

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions

Pg \_\_\_\_ of \_\_\_\_ Workorder # 23071463

Client: ENPAQ, LLC  
Address: 3130 Gravois Ave.  
City/State/Zip: Collinsville, IL 62234  
Contact: Anthony Hagerty Phone: (314) 449-1976  
Email: tony.hagerty@enpaqconsulting.com Fax: \_\_\_\_\_

Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE \_\_\_\_\_ °C  
Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY  
LAB NOTES:

**Client Comments:** Hazelwood North Middle School  
Please Report in PPB

Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No

Are these samples known to be hazardous? ☐ Yes ☒ No

Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No

**SAMPLE COLLECTOR'S NAME**

Hazelwood SD/ 23-170

J. E. ...

**BILLING INSTRUCTIONS**

☒ Standard ☐ 1-2 Day (100% Surcharge)  
☐ Other ☐ 3 Day (50% Surcharge)

[illegible]

## Relinquished By

**Date/Time**

Received By

Date/Time

7/2e/23

Монгуш Редья

7/20/23	57M
---------	-----

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions



Prep Day: 7/19/23

Sample Day: 7/20/23

To Lab -----> 7/20/23

\* Reporting Limit

# to Test =  
# Disabled =  
# of Samples =  
# > 10.0 ppb =  
# > 0.5 ppb =

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
01	(A)	S	Kitchen Prep Sink #1		1.0	ppb
	(B)	S	Kitchen Prep Sink #1		1.0	ppb
	(C)				1.0	ppb
02	(A)	S	Kitchen Prep Sink #2		1.0	ppb
	(B)	S	Kitchen Prep Sink #2		1.0	ppb
03	(A)	S	Kitchen Prep Sink #3		1.0	ppb
	(B)	S	Kitchen Prep Sink #3		1.0	ppb
04	(A)	S	Kitchen Prep Sink #4		1.0	ppb
	(B)	S	Kitchen Prep Sink #4		1.0	ppb
05	(A)	S	Pot Filler		1.0	ppb
	(B)	S	Pot Filler		1.0	ppb
06	(A)	S	Dishwashing Sink- Left		1.0	ppb
	(B)	S	Dishwashing Sink- Left		1.0	ppb
07	(A)	S	Dishwashing Sink- Center		1.0	ppb
	(B)	S	Dishwashing Sink- Center		1.0	ppb
08	(A)	S	Dishwashing Sink- Right		1.0	ppb
	(B)	S	Dishwashing Sink- Right		1.0	ppb
09	(A)	F	Café Fountain		1.0	ppb
	(B)	F	Café Fountain		1.0	ppb
10	(A)	F	Gym Fountain- Left		1.0	ppb
	(B)	F	Gym Fountain- Left		1.0	ppb
11	(A)	F	Gym Fountain- Right		1.0	ppb
	(B)	F	Gym Fountain- Right		1.0	ppb

##

(Continuation Sheet)

25011702

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
12	(A)	F	Band Hallway Fountain- Left		1.0	ppb
	(B)	F	Band Hallway Fountain- Left		1.0	ppb
13	(A)	F	Band Hallway Fountain- Right		1.0	ppb
	(B)	F	Band Hallway Fountain- Right		1.0	ppb
14	(A)	S	Nurse Office Sink		-	ppb
	(B)	S	Nurse Office Sink		-	ppb
15	(A)	F	Fountain O/S Room 126- Left		1.0	ppb
	(B)	F	Fountain O/S Room 126- Left		1.0	ppb
16	(A)	F	Fountain O/S Room 126- Right		1.0	ppb
	(B)	F	Fountain O/S Room 126- Right		1.0	ppb
17	(A)	F	Fountain O/S Room 101- Left		1.0	ppb
	(B)	F	Fountain O/S Room 101- Left		1.0	ppb
18	(A)	F	Fountain O/S Room 101- Right		1.0	ppb
	(B)	F	Fountain O/S Room 101- Right		1.0	ppb
19	(A)	S	Room 101 Sink		1.0	ppb
	(B)	S	Room 101 Sink		1.0	ppb
20	(A)	S	Room 201 Sink		1.0	ppb
	(B)	S	Room 201 Sink		1.0	ppb
21	(A)	F	Fountain O/S Room 201- Left		1.0	ppb
	(B)	F	Fountain O/S Room 201- Left		1.0	ppb
22	(A)	F	Fountain O/S Room 201- Right		1.0	ppb
	(B)	F	Fountain O/S Room 201- Right		1.0	ppb
23	(A)	F	Fountain O/S Room 221- Left		1.0	ppb
	(B)	F	Fountain O/S Room 221- Left		1.0	ppb
24	(A)	F	Fountain O/S Room 221- Right		1.0	ppb
	(B)	F	Fountain O/S Room 221- Right		1.0	ppb
25	(A)	S	Teachers Lounge 221		1.0	ppb
	(B)	S	Teachers Lounge 221		1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
--------	-------------	-------------	-----------------	--------------	------	------------------

26071405

26	(A)	F	Founain O/S Room 321- Left	1.0	ppb
	(B)	F	Founain O/S Room 321- Left	1.0	ppb
27	(A)	F	Founain O/S Room 321- Right	1.0	ppb
	(B)	F	Founain O/S Room 321- Right	1.0	ppb
28	(A)	S	Room 321- Left	1.0	ppb
	(B)	S	Room 321- Left	1.0	ppb
29	(A)	S	Room 321- Right	-	ppb
	(B)	S	Room 321- Right	-	ppb
30	(A)	F	Fountain O/S Room 301- Left	-	ppb
	(B)	F	Fountain O/S Room 301- Left	-	ppb
31	(A)	F	Fountain O/S Room 301- Right	2.0	ppb
	(B)	F	Fountain O/S Room 301- Right	1.0	ppb
32	(A)	S	Room 301	-	ppb
	(B)	S	Room 301	-	ppb
33	(A)			1.0	ppb
	(B)			1.0	ppb
34	(A)			1.0	ppb
	(B)			1.0	ppb
35	(A)			1.0	ppb
	(B)			1.0	ppb
36	(A)			1.0	ppb
	(B)			1.0	ppb
37	(A)			1.0	ppb
	(B)			1.0	ppb
38	(A)			1.0	ppb
	(B)			1.0	ppb
39	(A)			1.0	ppb
	(B)			1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
40	(A)				1.0	ppb

23071463

	(B)			1.0	ppb
41	(A)			1.0	ppb
	(B)			1.0	ppb
42	(A)			1.0	ppb
	(B)			1.0	ppb
43	(A)			1.0	ppb
	(B)			1.0	ppb
44	(A)			1.0	ppb
	(B)			1.0	ppb
45	(A)			1.0	ppb
	(B)			1.0	ppb
46	(A)			1.0	ppb
	(B)			1.0	ppb
47	(A)			1.0	ppb
	(B)			1.0	ppb
48	(A)			1.0	ppb
	(B)			1.0	ppb
49	(A)			1.0	ppb
	(B)			1.0	ppb
50	(A)			1.0	ppb
	(B)			1.0	ppb
51	(A)			1.0	ppb
	(B)			1.0	ppb
52	(A)			1.0	ppb
	(B)			1.0	ppb
53	(A)			1.0	ppb
	(B)			1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
54	(A)				1.0	ppb
	(B)				1.0	ppb

12501405



55	(A)			1.0	ppb
	(B)			1.0	ppb
56	(A)			1.0	ppb
	(B)			1.0	ppb
57	(A)			1.0	ppb
	(B)			1.0	ppb
58	(A)			1.0	ppb
	(B)			1.0	ppb
59	(A)			1.0	ppb
	(B)			1.0	ppb
60	(A)			1.0	ppb
	(B)			1.0	ppb
61	(A)			1.0	ppb
	(B)			1.0	ppb
62	(A)			1.0	ppb
	(B)			1.0	ppb
63	(A)			1.0	ppb
	(B)			1.0	ppb
64	(A)			1.0	ppb
	(B)			1.0	ppb
65	(A)			1.0	ppb
	(B)			1.0	ppb
66	(A)			1.0	ppb
	(B)			1.0	ppb
67	(A)			1.0	ppb
	(B)			1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
68	(A)				1.0	ppb
	(B)				1.0	ppb

16014-05

**Sample ID Coding Key:**

F = Fountain

S = Sink

(A) = 1st Sample

(B) = 2nd Sample (30 Seconds Later)

(C) = 3rd Sample (3 Minutes Later)

## **APPENDIX C**

### **CREDENTIALS**

***STATE OF MISSOURI***  
***DEPARTMENT OF HEALTH AND SENIOR SERVICES***

**Lead Abatement Contractor License**


The person, firm or corporation whose name appears on this certificate is licensed as a Lead Abatement Contractor as set forth in the Missouri Revised Statutes 701.300-701.338 and 19 CSR 30-70.180, as long as not suspended or revoked, and is hereby authorized to engage in lead-bearing substance activities.

Issued to:

**ENPAQ, LLC**

**2321 Rutger Street, Unit F  
St. Louis, MO 63104**

Issuance Date: **2/10/2023**  
Expiration Date: **2/26/2025**  
License Number: **190226-004574**

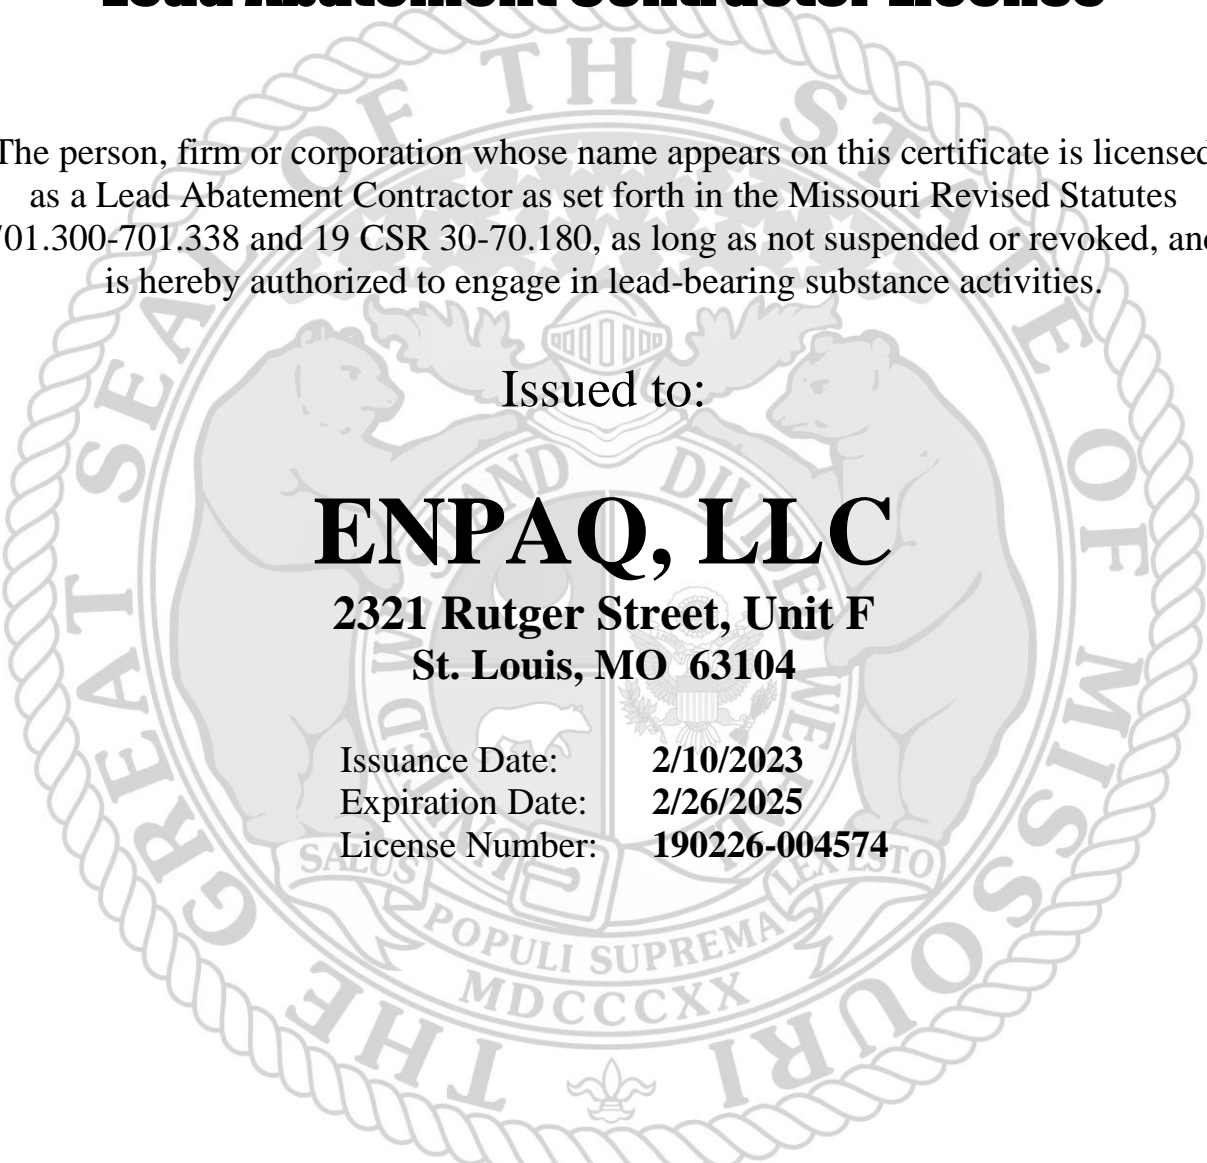

*Paula F. Nickelson*

Paula F. Nickelson  
Acting Director  
Department of Health and Senior Services



**STATE OF MISSOURI**  
**DEPARTMENT OF HEALTH AND SENIOR SERVICES**

**LEAD OCCUPATION LICENSE REGISTRATION**

Issued to:

**Anthony W. Hagerty**

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

**Lead Risk Assessor**  
Category of License

Issuance Date: **10/17/2022**  
Expiration Date: **10/31/2024**  
License Number: **161031-300005062**



*Paula F. Nickelson*

Paula F. Nickelson  
Acting Director  
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102



COLLEGE FOR  
**PUBLIC HEALTH & SOCIAL JUSTICE**  
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

**Anthony Hagerty**

3959 McDonald Ave, St. Louis, MO 63116

has attended 8 contact hours of training and successfully passed an examination

**Lead Risk Assessor Refresher**

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 190510

Examination Date: 3/7/2022

CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104  
(314) 977-8256 [slu.edu/x39753.xml](http://slu.edu/x39753.xml)

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

*Christopher C. King*  
Christopher C. King PhD  
Director, Center for Environmental  
Education and Training



**STATE OF MISSOURI**  
**DEPARTMENT OF HEALTH AND SENIOR SERVICES**

**LEAD OCCUPATION LICENSE REGISTRATION**

Issued to:

**James T. Earle**

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

**Lead Risk Assessor**  
Category of License

Issuance Date: **7/30/2022**  
Expiration Date: **7/30/2024**  
License Number: **180730-300005561**



*Paula F. Nickelson*

Paula F. Nickelson  
Acting Director  
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102



COLLEGE FOR  
**PUBLIC HEALTH & SOCIAL JUSTICE**  
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

**James Earle**

7484 Ahern Ct., University City, MO 63130

has attended 8 contact hours of training and successfully passed an examination

**Lead Risk Assessor Refresher**

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117401  
Examination Date: 3/7/2022  
CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104  
(314) 977-8256 sltu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

*Christopher C. King*  
**Christopher C. King PhD**  
Director, Center for Environmental  
Education and Training



**STATE OF MISSOURI**  
**DEPARTMENT OF HEALTH AND SENIOR SERVICES**

**LEAD OCCUPATION LICENSE REGISTRATION**

Issued to:

**Zachary A. Haselhorst**

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

**Lead Risk Assessor**  
Category of License

Issuance Date: **3/1/2022**  
Expiration Date: **3/1/2024**  
License Number: **160229-300004899**



A handwritten signature in black ink, appearing to read 'Richard W. Moore', is positioned above the printed name.

Richard W. Moore  
Acting Director  
Department of Health and Senior Services



COLLEGE FOR  
**PUBLIC HEALTH & SOCIAL JUSTICE**  
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

**Zachary Haselhorst**

209 E 5th St, Trenton, IL 62293

has attended 8 contact hours of training and successfully passed an examination

**Lead Risk Assessor Refresher**

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117400  
Examination Date: 3/7/2022  
CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104  
(314) 977-8256 [slu.edu/x39753.xml](mailto:slu.edu/x39753.xml)

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

*Christopher C. King*  
**Christopher C. King PhD**  
Director, Center for Environmental  
Education and Training

**State of Missouri**  
**Department of Natural Resources**

**Certificate of Approval**  
**for Chemical Laboratory Service**

This is to certify that

**Teklab, Incorporated**

is hereby approved to perform the analysis of drinking water as specified on the  
Certified Parameter List, which must accompany this certificate to be valid.

Certification Number 930

Date Issued December 13, 2021

Expiration Date January 31, 2025



Laboratory Certification Authority, Public Drinking Water Branch  
Missouri Department of Natural Resources



Laboratory Certification Officer, Environmental Services Program  
Missouri Department of Natural Resources

**MISSOURI DEPARTMENT OF NATURAL RESOURCES**  
**DRINKING WATER LABORATORY**  
**CERTIFIED PARAMETER LIST**

This is to certify that

**Teklab, Incorporated**

located at

**5445 Horseshoe Lake Road, Collinsville, IL 62234**

has been approved to perform the indicated procedures on drinking water under the Missouri Public Drinking Water Regulations (10 CSR 60-5.020). Specific method numbers or references are included in parenthesis when appropriate.

**INORGANIC**

**EPA 335.4**  
Total Cyanide

**EPA 353.2**  
Nitrate, Nitrite, Total Nitrate and Nitrite

**EPA 245.1**  
Mercury

**EPA 200.7**  
Barium, Beryllium, Cadmium, Chromium, Copper, Nickel

**EPA 200.8**  
Antimony, Arsenic, Barium, Beryllium, Cadmium, Chromium, Copper, Lead, Nickel,  
Selenium, Thallium

**SM4500F-C**  
Fluoride

**SM4500NO2-B**  
Nitrite

**Teklab, Incorporated**  
**Expiration Date: January 31, 2025**  
**Missouri Certificate No.: 930**  
**Original Certifying State: Illinois**