

# **REPORT OF DRINKING WATER SAMPLING FOR LEAD CONTENT:**

**RUSSELL ELEMENTARY SCHOOL  
7350 HOWDERSHELL ROAD  
HAZELWOOD, MO 63042**



***PREPARED FOR:***

**MR. DAVID DUDLEY  
DIRECTOR OF MAINTENANCE  
HAZELWOOD SCHOOL DISTRICT  
15875 NEW HALLS FERRY RD  
FLORISSANT, MISSOURI 63031**

***PREPARED BY:***

**ENPAQ, LLC  
3130 GRAVOIS AVENUE  
ST. LOUIS, MISSOURI 63139**

**JULY 2023**

**DOCUMENT TO BE RETAINED INDEFINITELY**

# **TABLE OF CONTENTS**

23-170

Drinking Water Sampling for Lead  
Hazelwood School District  
Russell Elementary School  
7350 Howdershell Road  
Hazelwood, MO 63042

EXECUTIVE SUMMARY

APPENDIX A ..... Sample Locations/Results

APPENDIX B ..... Laboratory Analysis

APPENDIX C ..... Credentials

# EXECUTIVE SUMMARY

ENPAQ, LLC performed lead testing of multiple drinking fountain water sources at the Russell Elementary School located at 7350 Howdershell Road in Hazelwood, Missouri. The sampling was performed by trained and licensed personnel in accordance with USEPA, HUD, and State of Missouri Regulations and Guidelines.

All inspectors involved with sampling activities had EPA-approved training in Lead. Credentials for our firm and the inspector collecting the samples are included in Attachment C to this document.

All samples were collected on a “first draw” basis. “First draw” is achieved by allowing the water system to rest for at least eight hours prior to sampling in order to collect any existing debris or settlement within the sample. The intent of this sampling is to replicate “worst-case scenario” conditions. As such, ENPAQ inspectors met at the school to collect water samples before the systems were used by staff or students. A second sample from each water source was collected as a “follow-up” sample basis. “Follow-up” sampling is achieved by allowing the water system to run for thirty (30) seconds after the first draw sampling. The intent of this sampling is to determine if lead contamination may be in the water lines connected to the water sources and not just at the fixture. The sampling was completed in accordance with the Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* requirements. The Missouri SB681 *Get the Lead Out of Schools Drinking Water Act* and other regulatory agencies recommend that water sources run for at least thirty seconds and as long as two minutes prior to use to avoid settling within the water system.

Drinking water samples were collected from twenty (20) different locations throughout Russell Elementary School during the sampling event. The water samples were collected from drinking fountains utilized for drinking activities at the campus. After sample collection, samples were immediately delivered to Teklab, Inc. located in Collinsville, Illinois following strict chain of custody procedures. Teklab is a NELAP-accredited and State of Missouri-licensed laboratory specializing in drinking water analysis. Detailed sampling locations and sample results are located in Attachment A of this report.

**Any samples reported over 5.0 ppb should be re-sampled on an annual basis at a minimum.**

## CONCLUSION/RECOMMENDATIONS

At this time, ENPAQ recommends that all water sources testing at 5.0 ppb or above be removed from service. These sources are subject to additional maintenance activities and remediation prior to use. Before being put back into service, it is recommended these sources be re-tested to confirm compliance with acceptable levels.

Remediation includes decreasing lead concentrations below 5 parts per billion using methods such as replacement of plumbing, solder, fittings, or fixtures, installation of filters and filter devices, or other effective methods in accordance with Missouri SB681 *Get the Lead Out of Schools Drinking Water Act*.

In addition, all sources will be subject to an ongoing maintenance program and re-testing at appropriate intervals. **Any samples reported over 5.0 ppb should be re-sampled on an annual basis at a minimum.**

**Although no additional samples were identified above the action level, ENPAQ recommends that all water sources run for at least thirty seconds prior to use as recommended by the USEPA.**

# **APPENDIX A**

## **SAMPLE LOCATIONS & RESULTS**

**Prep Day: 7/24/23**

**Sample Day: 7/25/23**

**To Lab -----> 7/25/23**

\* Reporting Limit

# Disabled =	<b>0</b>
# of Samples =	<b>40</b>
# > 10.0 ppb =	<b>0</b>
# > 5.0 ppb =	<b>0</b>

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
01	(A)	S	Kitchen Prep Sink- Left		1.0	<1.0 ppb
	(B)	S	Kitchen Prep Sink- Left		1.0	<1.0 ppb
	(C)				1.0	N/A ppb
02	(A)	S	Kitchen Prep Sink- Right		1.0	<1.0 ppb
	(B)	S	Kitchen Prep Sink- Right		1.0	<1.0 ppb
03	(A)	S	Pot Filler		1.0	<1.0 ppb
	(B)	S	Pot Filler		1.0	<1.0 ppb
04	(A)	S	Dishwashing Sink		1.0	1.6 ppb
	(B)	S	Dishwashing Sink		1.0	<1.0 ppb
05	(A)	F	Café Fountain		1.0	<1.0 ppb
	(B)	F	Café Fountain		1.0	<1.0 ppb
06	(A)	I	Ice Maker		1.0	<1.0 ppb
	(B)	I	Ice Maker		1.0	<1.0 ppb
07	(A)	F	Fountain O/S Café- Left		1.0	<1.0 ppb
	(B)	F	Fountain O/S Café- Left		1.0	<1.0 ppb
08	(A)	F	Fountain O/S Café- Right		1.0	<1.0 ppb
	(B)	F	Fountain O/S Café- Right		1.0	<1.0 ppb
09	(A)	S	Nurse Office Sink		1.0	<1.0 ppb
	(B)	S	Nurse Office Sink		1.0	<1.0 ppb
10	(A)	F	Fountain O/S Room 33		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 33		1.0	<1.0 ppb
11	(A)	S	Sink O/S Room 33		1.0	<1.0 ppb
	(B)	S	Sink O/S Room 33		1.0	<1.0 ppb

## (Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
12	(A)	F	Fountain O/S Room 1		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 1		1.0	<1.0 ppb
13	(A)	S	Teachers Loungs Sink		1.0	<1.0 ppb
	(B)	S	Teachers Loungs Sink		1.0	<1.0 ppb
14	(A)	S	Room 2 Sink		1.0	<1.0 ppb
	(B)	S	Room 2 Sink		1.0	<1.0 ppb
15	(A)	S	Room 1 Sink		1.0	<1.0 ppb
	(B)	S	Room 1 Sink		1.0	<1.0 ppb
16	(A)	F	Fountain O/S Room 2		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 2		1.0	<1.0 ppb
17	(A)	S	Hallway Sink O/S Room 2		1.0	<1.0 ppb
	(B)	S	Hallway Sink O/S Room 2		1.0	<1.0 ppb
18	(A)	F	Fountain O/S Room 5		1.0	<1.0 ppb
	(B)	F	Fountain O/S Room 5		1.0	<1.0 ppb
19	(A)	F	Gym Fountain		1.0	1.6 ppb
	(B)	F	Gym Fountain		1.0	<1.0 ppb
20	(A)	F	Fountain Near Girls Restrooms		1.0	<1.0 ppb
	(B)	F	Fountain Near Girls Restrooms		1.0	<1.0 ppb

**Sample ID Coding Key:**


F = Fountain

S = Sink

(A) = 1st Sample

(B) = 2nd Sample (30 Seconds Later)

(C) = 3rd Sample (3 Minutes Later)

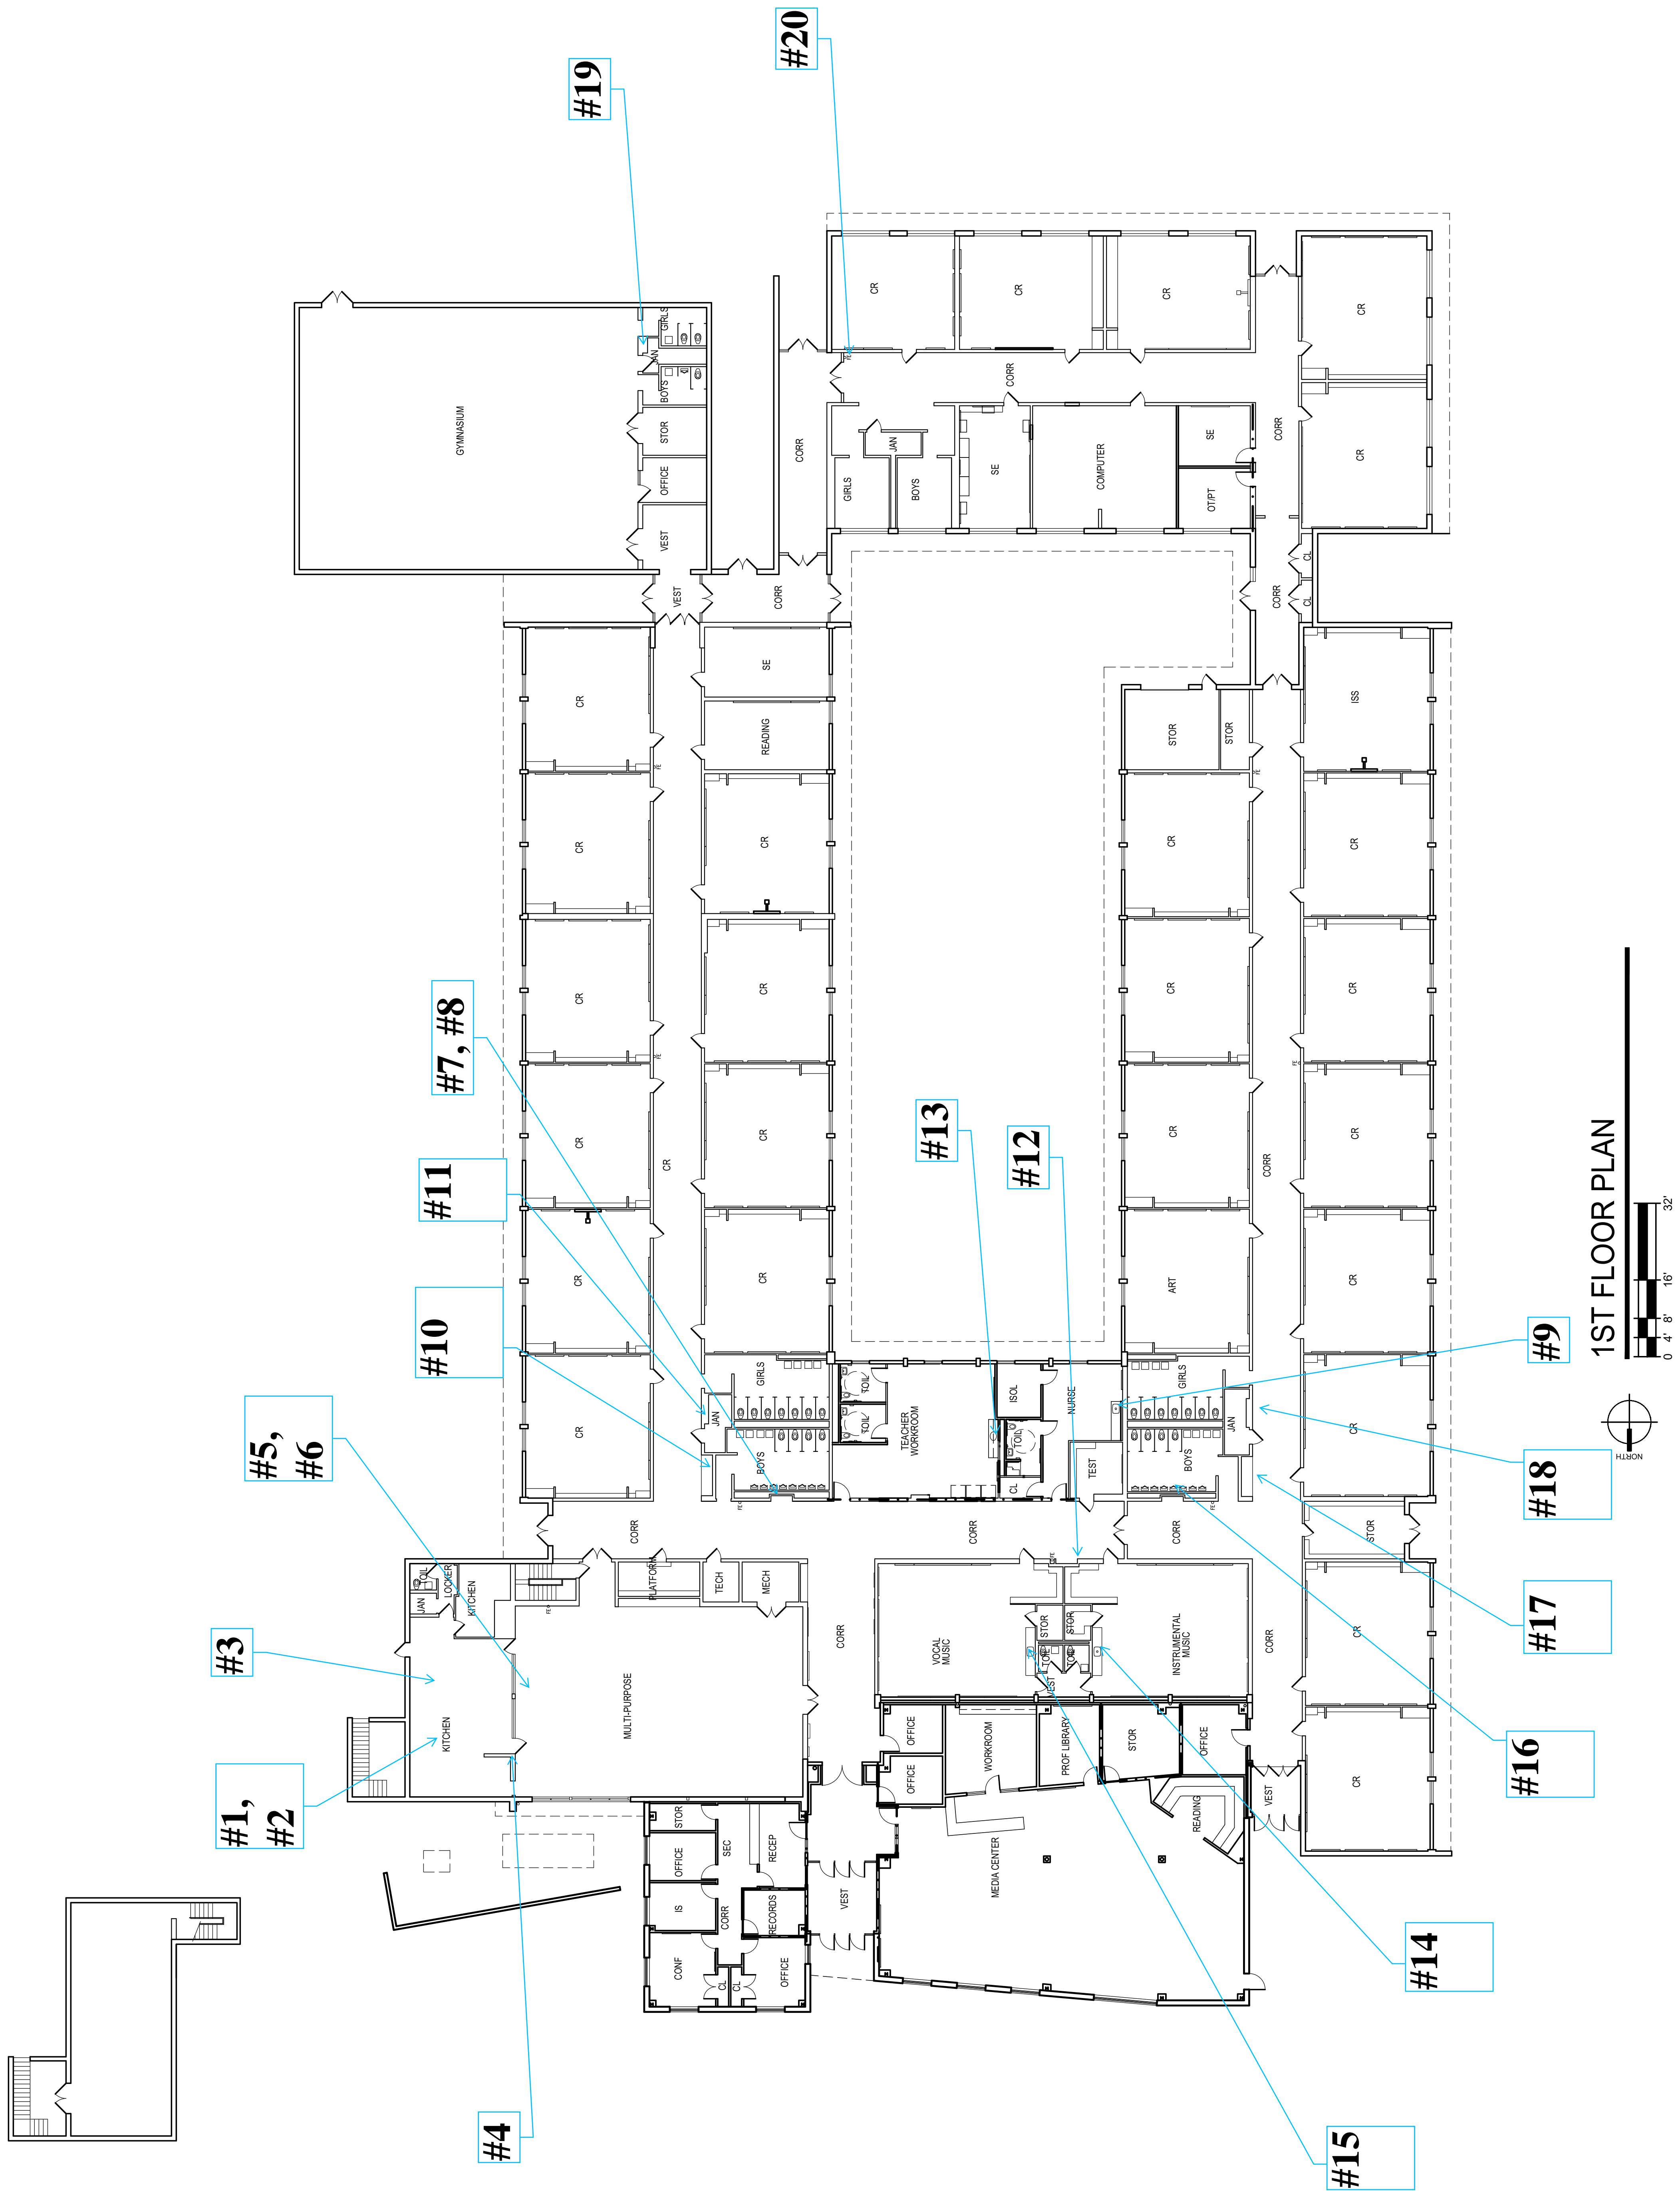

# RUSSELL ELEMENTARY SCHOOL

HAZELWOOD SCHOOL DISTRICT, ST. LOUIS COUNTY, MISSOURI  
21-100 03-09-2021



## **APPENDIX B**

### **LABORATORY ANALYSIS**

August 29, 2023

Tony Hagerty  
ENPAQ, LLC  
3130 Gravois Ave  
St. Louis, MO 63118  
TEL: (314) 449-1976  
FAX:



Illinois	100226
Kansas	E-10374
Louisiana	05002
Louisiana	05003
Oklahoma	9978

**RE:** Hazelwood SD/23-170 Russell Elem

**WorkOrder:** 23071726

Dear Tony Hagerty:

TEKLAB, INC received 40 samples on 7/25/2023 11:18:00 AM for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Marvin L. Darling  
Project Manager  
(618)344-1004 ex 41  
[mdarling@teklabinc.com](mailto:mdarling@teklabinc.com)



## Report Contents

<http://www.teklabinc.com/>

**Client:** ENPAQ, LLC

**Work Order:** 23071726

**Client Project:** Hazelwood SD/23-170 Russell Elem

**Report Date:** 29-Aug-23

**This reporting package includes the following:**

Cover Letter	1
Report Contents	2
Definitions	3
Case Narrative	5
Accreditations	6
Laboratory Results	7
Receiving Check List	8
Chain of Custody	Appended

**Client:** ENPAQ, LLC**Work Order:** 23071726**Client Project:** Hazelwood SD/23-170 Russell Elem**Report Date:** 29-Aug-23**Abbr Definition**

\* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count ( > 200 CFU )

**Client:** ENPAQ, LLC

**Work Order:** 23071726

**Client Project:** Hazelwood SD/23-170 Russell Elem

**Report Date:** 29-Aug-23

### Qualifiers

- |   |  |
|---|--|
| # - Unknown hydrocarbon                               | B - Analyte detected in associated Method Blank              |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range                           |
| H - Holding times exceeded                            | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits        | M - Manual Integration used to determine area response       |
| ND - Not Detected at the Reporting Limit              | R - RPD outside accepted recovery limits                     |
| S - Spike Recovery outside recovery limits            | T - TIC(Tentatively identified compound)                     |
| X - Value exceeds Maximum Contaminant Level           |  |



## Case Narrative

<http://www.teklabinc.com/>

**Client:** ENPAQ, LLC

**Work Order:** 23071726

**Client Project:** Hazelwood SD/23-170 Russell Elem

**Report Date:** 29-Aug-23

**Cooler Receipt Temp:** N/A °C

---

### Locations

---

#### Collinsville

**Address** 5445 Horseshoe Lake Road  
Collinsville, IL 62234-7425  
**Phone** (618) 344-1004  
**Fax** (618) 344-1005  
**Email** jhriley@teklabinc.com

---

#### Collinsville Air

**Address** 5445 Horseshoe Lake Road  
Collinsville, IL 62234-7425  
**Phone** (618) 344-1004  
**Fax** (618) 344-1005  
**Email** EHurley@teklabinc.com

---

#### Springfield

**Address** 3920 Pintail Dr  
Springfield, IL 62711-9415  
**Phone** (217) 698-1004  
**Fax** (217) 698-1005  
**Email** KKlostermann@teklabinc.com

---

#### Chicago

**Address** 1319 Butterfield Rd.  
Downers Grove, IL 60515  
**Phone** (630) 324-6855  
**Fax**  
**Email** arenner@teklabinc.com

---

#### Kansas City

**Address** 8421 Nieman Road  
Lenexa, KS 66214  
**Phone** (913) 541-1998  
**Fax** (913) 541-1998  
**Email** jhriley@teklabinc.com

**Client:** ENPAQ, LLC**Work Order:** 23071726**Client Project:** Hazelwood SD/23-170 Russell Elem**Report Date:** 29-Aug-23

State	Dept	Cert #	NELAP	Exp Date	Lab
Illinois	IEPA	100226	NELAP	1/31/2024	Collinsville
Kansas	KDHE	E-10374	NELAP	4/30/2024	Collinsville
Louisiana	LDEQ	05002	NELAP	6/30/2024	Collinsville
Louisiana	LDEQ	05003	NELAP	6/30/2024	Collinsville
Oklahoma	ODEQ	9978	NELAP	8/31/2023	Collinsville
Arkansas	ADEQ	88-0966		3/14/2024	Collinsville
Illinois	IDPH	17584		5/31/2025	Collinsville
Iowa	IDNR	430		6/1/2024	Collinsville
Kentucky	UST	0073		1/31/2024	Collinsville
Missouri	MDNR	00930		5/31/2023	Collinsville
Missouri	MDNR	930		1/31/2025	Collinsville



## Laboratory Results

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071726

Client Project: Hazelwood SD/23-170 Russell Elem

Report Date: 29-Aug-23

Matrix: DRINKING WATER

Sample ID	Client Sample ID	Certification	Qual	RL	Result	Units	DF	Date Analyzed	Date Collected
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)									
Lead									
23071726-001A	01A	NELAP		1.0	< 1.0	µg/L	1	08/28/2023 14:32	07/25/2023 0:00
23071726-002A	01B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 19:13	07/25/2023 0:00
23071726-003A	02A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 19:16	07/25/2023 0:00
23071726-004A	02B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 19:20	07/25/2023 0:00
23071726-005A	03A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 19:24	07/25/2023 0:00
23071726-006A	03B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 19:27	07/25/2023 0:00
23071726-007A	04A	NELAP		1.0	1.6	µg/L	1	08/26/2023 19:31	07/25/2023 0:00
23071726-008A	04B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 19:57	07/25/2023 0:00
23071726-009A	05A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:00	07/25/2023 0:00
23071726-010A	05B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:04	07/25/2023 0:00
23071726-011A	06A	NELAP		1.0	< 1.0	µg/L	1	08/28/2023 14:43	07/25/2023 0:00
23071726-012A	06B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:08	07/25/2023 0:00
23071726-013A	07A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:11	07/25/2023 0:00
23071726-014A	07B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:15	07/25/2023 0:00
23071726-015A	08A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:19	07/25/2023 0:00
23071726-016A	08B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:44	07/25/2023 0:00
23071726-017A	09A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:48	07/25/2023 0:00
23071726-018A	09B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:52	07/25/2023 0:00
23071726-019A	10A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:55	07/25/2023 0:00
23071726-020A	10B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 20:59	07/25/2023 0:00
23071726-021A	11A	NELAP		1.0	< 1.0	µg/L	1	08/28/2023 15:05	07/25/2023 0:00
23071726-022A	11B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 21:03	07/25/2023 0:00
23071726-023A	12A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 21:06	07/25/2023 0:00
23071726-024A	12B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 21:32	07/25/2023 0:00
23071726-025A	13A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 21:36	07/25/2023 0:00
23071726-026A	13B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 21:39	07/25/2023 0:00
23071726-027A	14A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 16:02	07/25/2023 0:00
23071726-028A	14B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 16:06	07/25/2023 0:00
23071726-029A	15A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 16:09	07/25/2023 0:00
23071726-030A	15B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 16:13	07/25/2023 0:00
23071726-031A	16A	NELAP		1.0	< 1.0	µg/L	1	08/28/2023 14:21	07/25/2023 0:00
23071726-032A	16B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 16:17	07/25/2023 0:00
23071726-033A	17A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 16:20	07/25/2023 0:00
23071726-034A	17B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 16:46	07/25/2023 0:00
23071726-035A	18A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 16:50	07/25/2023 0:00
23071726-036A	18B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 16:53	07/25/2023 0:00
23071726-037A	19A	NELAP		1.0	1.6	µg/L	1	08/26/2023 16:57	07/25/2023 0:00
23071726-038A	19B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 17:01	07/25/2023 0:00
23071726-039A	20A	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 17:04	07/25/2023 0:00
23071726-040A	20B	NELAP		1.0	< 1.0	µg/L	1	08/26/2023 17:08	07/25/2023 0:00





## Receiving Check List

<http://www.teklabinc.com/>

Client: ENPAQ, LLC

Work Order: 23071726

Client Project: Hazelwood SD/23-170 Russell Elem

Report Date: 29-Aug-23

Carrier: Anthony Hagerty

Received By: MBP

Completed by:

Reviewed by:

On:

On:

27-Jul-23

27-Jul-23

Lindsey Maddox

Ellie Hopkins

Pages to follow:

Chain of custody

4

Extra pages included

6

Shipping container/cooler in good condition?

Yes ☒

No ☐

Not Present ☐

Temp °C N/A

Type of thermal preservation?

None ☒

Ice ☐

Blue Ice ☐

Dry Ice ☐

Chain of custody present?

Yes ☒

No ☐

Chain of custody signed when relinquished and received?

Yes ☒

No ☐

Chain of custody agrees with sample labels?

Yes ☒

No ☐

Samples in proper container/bottle?

Yes ☒

No ☐

Sample containers intact?

Yes ☒

No ☐

Sufficient sample volume for indicated test?

Yes ☒

No ☐

All samples received within holding time?

Yes ☒

No ☐

Reported field parameters measured:

Field ☐

Lab ☐

NA ☒

Container/Temp Blank temperature in compliance?

Yes ☒

No ☐

When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.

Water – at least one vial per sample has zero headspace?

Yes ☐

No ☐

No VOA vials ☒

Water - TOX containers have zero headspace?

Yes ☐

No ☐

No TOX containers ☒

Water - pH acceptable upon receipt?

Yes ☒

No ☐

NA ☐

NPDES/CWA TCN interferences checked/treated in the field?

Yes ☐

No ☐

NA ☒

Any No responses must be detailed below or on the COC.

Samples were checked for turbidity and then preserved with nitric acid upon arrival in the laboratory. - lmaddox - 7/27/2023 10:26:05 AM

## CHAIN OF CUSTODY

Pg 8 of 4 Workorder # 23071726

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

[illegible]

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

[illegible]

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

[illegible]

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions

Pg 4 of 4 Workorder # 73071726

Client: ENPAQ, LLC  
Address: 3130 Gravois Ave.  
City/State/Zip: Collinsville, IL 62234  
Contact: Anthony Hagerty Phone: (314) 449-1976  
Email: tony.hagerty@enpaqconsulting.com Fax: \_\_\_\_\_

Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE \_\_\_\_\_ °C  
Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY

Please Report in PPB

Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No

Are these samples known to be hazardous? ☐ Yes ☒ No

Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No

SAMPLE COLLECTOR'S NAME

Hazelwood SD/ 23-170

Anthony Hunt

## BILLING INSTRUCTIONS

☒ Standard ☐ 1-2 Day (100% Surcharge)  
☐ Other \_\_\_\_\_ ☐ 3 Day (50% Surcharge)

Lab Use Only	Sample ID	Date/Time Sampled	Matrix
23071726-031	16 A	7/25/23	Aqueous
032	16 B		Aqueous
033	17 A		Aqueous
034	17 B		Aqueous
035	18 A		Aqueous
036	18 B		Aqueous
037	19 A		Aqueous
038	19 B		Aqueous
039	20 A		Aqueous
040	20 B		Aqueous
			Aqueous

Date/Time

A Hay 5

7/29/23

Morayra Peña

7/25/23	119
---------	-----

\*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions

Prep Day: 7/24/23

Sample Day: 7/25/23

To Lab -----> 7/25/23

\* Reporting Limit

# to Test =

# Disabled =

# of Samples =

# > 10.0 ppb =

# > 0.5 ppb =

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
01	(A)	S	Kitchen Prep Sink- Left		1.0	ppb
	(B)	S	Kitchen Prep Sink- Left		1.0	1.0 ppb
	(C)				1.0	22.0 ppb
02	(A)	S	Kitchen Prep Sink- Right		1.0	135.0 ppb
	(B)	S	Kitchen Prep Sink- Right		1.0	ppb
03	(A)	S	Pot Filler		1.0	ppb
	(B)	S	Pot Filler		1.0	ppb
04	(A)	S	Dishwashing Sink		1.0	ppb
	(B)	S	Dishwashing Sink		1.0	ppb
05	(A)	F	Café Fountain		1.0	ppb
	(B)	F	Café Fountain		1.0	ppb
06	(A)	I	Ice Maker		1.0	ppb
	(B)	I	Ice Maker		1.0	ppb
07	(A)	F	Fountain O/S Café- Left		1.0	ppb
	(B)	F	Fountain O/S Café- Left		1.0	ppb
08	(A)	F	Fountain O/S Café- Right		1.0	ppb
	(B)	F	Fountain O/S Café- Right		1.0	ppb
09	(A)	S	Nurse Office Sink		1.0	ppb
	(B)	S	Nurse Office Sink		1.0	ppb
10	(A)	F	Fountain O/S Room 33		1.0	ppb
	(B)	F	Fountain O/S Room 33		1.0	ppb
11	(A)	S	Sink O/S Room 33		1.0	ppb
	(B)	S	Sink O/S Room 33		1.0	ppb

##

(Continuation Sheet)

75011/20

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
12	(A)	F	Fountain O/S Room 1		1.0	ppb
	(B)	F	Fountain O/S Room 1		1.0	ppb
13	(A)	S	Teachers Loungs Sink		1.0	ppb
	(B)	S	Teachers Loungs Sink		1.0	ppb
14	(A)	S	Room 2 Sink		-	ppb
	(B)	S	Room 2 Sink		-	ppb
15	(A)	S	Room 1 Sink		1.0	ppb
	(B)	S	Room 1 Sink		1.0	ppb
16	(A)	F	Fountain O/S Room 2		1.0	ppb
	(B)	F	Fountain O/S Room 2		1.0	ppb
17	(A)	S	Hallway Sink O/S Room 2		1.0	ppb
	(B)	S	Hallway Sink O/S Room 2		1.0	ppb
18	(A)	F	Fountain O/S Room 5		1.0	ppb
	(B)	F	Fountain O/S Room 5		1.0	ppb
19	(A)	F	Gym Fountain		1.0	ppb
	(B)	F	Gym Fountain		1.0	ppb
20	(A)	F	Fountain Near Girls Restrooms		1.0	ppb
	(B)	F	Fountain Near Girls Restrooms		1.0	ppb
21	(A)				1.0	ppb
	(B)				1.0	ppb
22	(A)				1.0	ppb
	(B)				1.0	ppb
23	(A)				1.0	ppb
	(B)				1.0	ppb
24	(A)				1.0	ppb
	(B)				1.0	ppb
25	(A)				1.0	ppb
	(B)				1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
--------	-------------	-------------	-----------------	--------------	------	------------------

15071720

26	(A)				1.0	ppb
	(B)				1.0	ppb
27	(A)				1.0	ppb
	(B)				1.0	ppb
28	(A)				1.0	ppb
	(B)				1.0	ppb
29	(A)				-	ppb
	(B)				-	ppb
30	(A)				-	ppb
	(B)				-	ppb
31	(A)				2.0	ppb
	(B)				1.0	ppb
32	(A)				-	ppb
	(B)				-	ppb
33	(A)				1.0	ppb
	(B)				1.0	ppb
34	(A)				1.0	ppb
	(B)				1.0	ppb
35	(A)				1.0	ppb
	(B)				1.0	ppb
36	(A)				1.0	ppb
	(B)				1.0	ppb
37	(A)				1.0	ppb
	(B)				1.0	ppb
38	(A)				1.0	ppb
	(B)				1.0	ppb
39	(A)				1.0	ppb
	(B)				1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
40	(A)				1.0	ppb

13071724



	(B)			1.0	ppb
41	(A)			1.0	ppb
	(B)			1.0	ppb
42	(A)			1.0	ppb
	(B)			1.0	ppb
43	(A)			1.0	ppb
	(B)			1.0	ppb
44	(A)			1.0	ppb
	(B)			1.0	ppb
45	(A)			1.0	ppb
	(B)			1.0	ppb
46	(A)			1.0	ppb
	(B)			1.0	ppb
47	(A)			1.0	ppb
	(B)			1.0	ppb
48	(A)			1.0	ppb
	(B)			1.0	ppb
49	(A)			1.0	ppb
	(B)			1.0	ppb
50	(A)			1.0	ppb
	(B)			1.0	ppb
51	(A)			1.0	ppb
	(B)			1.0	ppb
52	(A)			1.0	ppb
	(B)			1.0	ppb
53	(A)			1.0	ppb
	(B)			1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
54	(A)				1.0	ppb
	(B)				1.0	ppb

25011720

55	(A)			1.0	ppb
	(B)			1.0	ppb
56	(A)			1.0	ppb
	(B)			1.0	ppb
57	(A)			1.0	ppb
	(B)			1.0	ppb
58	(A)			1.0	ppb
	(B)			1.0	ppb
59	(A)			1.0	ppb
	(B)			1.0	ppb
60	(A)			1.0	ppb
	(B)			1.0	ppb
61	(A)			1.0	ppb
	(B)			1.0	ppb
62	(A)			1.0	ppb
	(B)			1.0	ppb
63	(A)			1.0	ppb
	(B)			1.0	ppb
64	(A)			1.0	ppb
	(B)			1.0	ppb
65	(A)			1.0	ppb
	(B)			1.0	ppb
66	(A)			1.0	ppb
	(B)			1.0	ppb
67	(A)			1.0	ppb
	(B)			1.0	ppb

##

(Continuation Sheet)

Source	Sample ID #	Sample Type	Sample Location	Source Notes	RL *	Lead Test Result
68	(A)				1.0	ppb
	(B)				1.0	ppb

23071726

**Sample ID Coding Key:**

- F = Fountain
- S = Sink
- (A) = 1st Sample
- (B) = 2nd Sample (30 Seconds Later)
- (C) = 3rd Sample (3 Minutes Later)

## **APPENDIX C**

### **CREDENTIALS**

***STATE OF MISSOURI***  
***DEPARTMENT OF HEALTH AND SENIOR SERVICES***

**Lead Abatement Contractor License**


The person, firm or corporation whose name appears on this certificate is licensed as a Lead Abatement Contractor as set forth in the Missouri Revised Statutes 701.300-701.338 and 19 CSR 30-70.180, as long as not suspended or revoked, and is hereby authorized to engage in lead-bearing substance activities.

Issued to:

**ENPAQ, LLC**

**2321 Rutger Street, Unit F  
St. Louis, MO 63104**

Issuance Date: **2/10/2023**  
Expiration Date: **2/26/2025**  
License Number: **190226-004574**

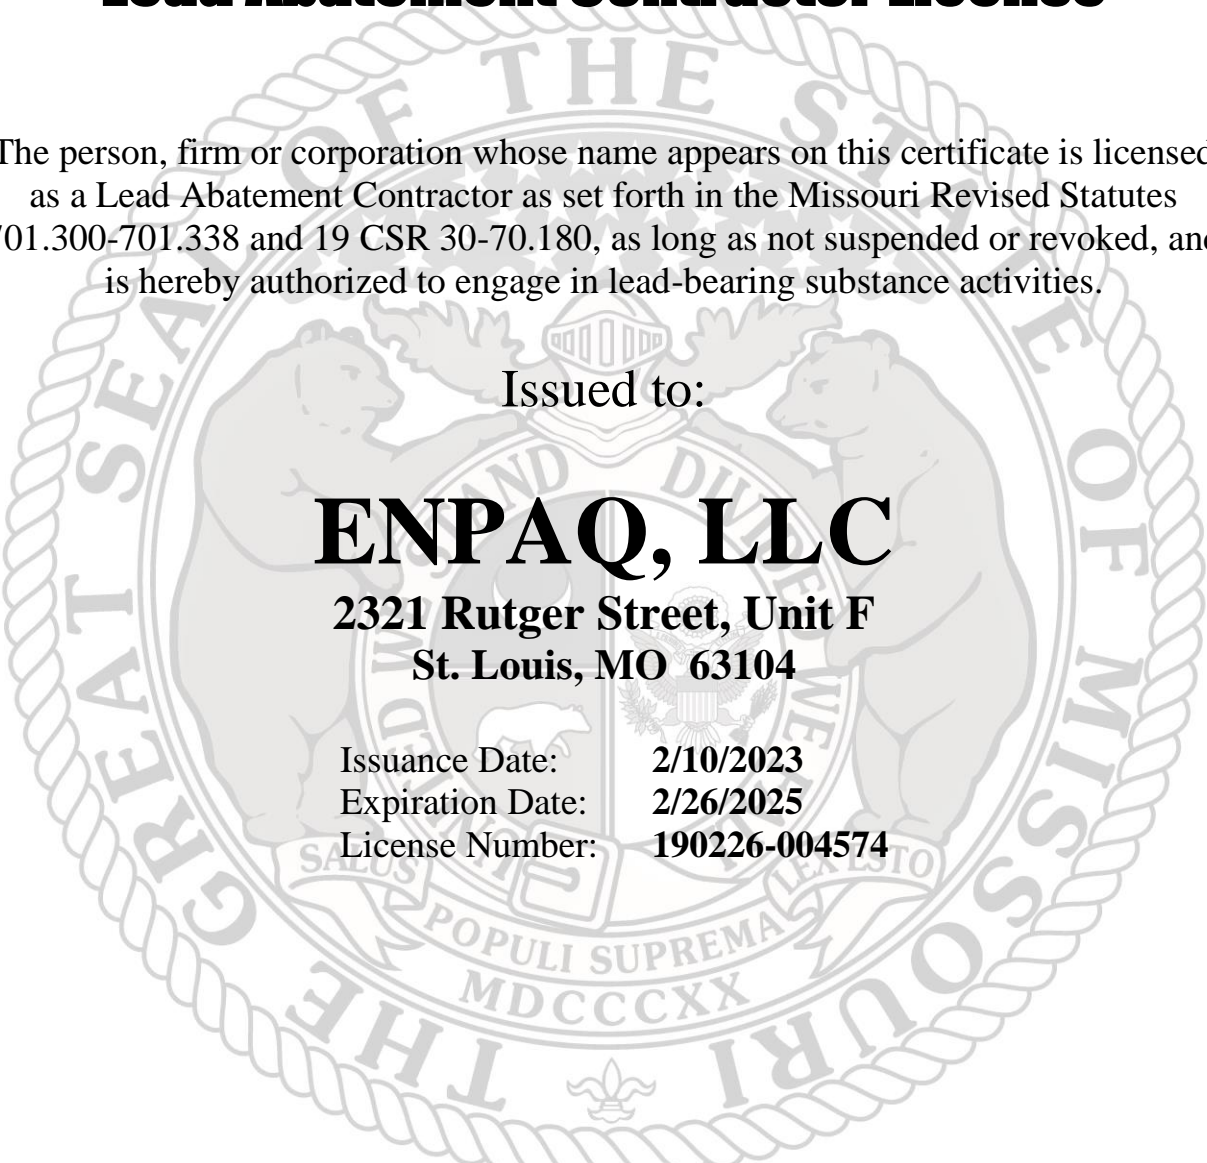

*Paula F. Nickelson*

Paula F. Nickelson  
Acting Director  
Department of Health and Senior Services



**STATE OF MISSOURI**  
**DEPARTMENT OF HEALTH AND SENIOR SERVICES**

**LEAD OCCUPATION LICENSE REGISTRATION**

Issued to:

**Anthony W. Hagerty**

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

**Lead Risk Assessor**  
Category of License

Issuance Date: **10/17/2022**  
Expiration Date: **10/31/2024**  
License Number: **161031-300005062**



*Paula F. Nickelson*

Paula F. Nickelson  
Acting Director  
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102



COLLEGE FOR  
**PUBLIC HEALTH & SOCIAL JUSTICE**  
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

**Anthony Hagerty**

3959 McDonald Ave, St. Louis, MO 63116

has attended 8 contact hours of training and successfully passed an examination

**Lead Risk Assessor Refresher**

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 190510

Examination Date: 3/7/2022

CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104

(314) 977-8256 [slu.edu/x39753.xml](http://slu.edu/x39753.xml)

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

*Christopher C. King*  
Christopher C. King PhD  
Director, Center for Environmental  
Education and Training



**STATE OF MISSOURI**  
**DEPARTMENT OF HEALTH AND SENIOR SERVICES**

**LEAD OCCUPATION LICENSE REGISTRATION**

Issued to:

**James T. Earle**

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

**Lead Risk Assessor**  
Category of License

Issuance Date: **7/30/2022**  
Expiration Date: **7/30/2024**  
License Number: **180730-300005561**



*Paula F. Nickelson*

Paula F. Nickelson  
Acting Director  
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102



COLLEGE FOR  
**PUBLIC HEALTH & SOCIAL JUSTICE**  
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

**James Earle**

7484 Ahern Ct., University City, MO 63130

has attended 8 contact hours of training and successfully passed an examination

**Lead Risk Assessor Refresher**

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117401  
Examination Date: 3/7/2022  
CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104  
(314) 977-8256 sltu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

*Christopher C. King*  
**Christopher C. King PhD**  
Director, Center for Environmental  
Education and Training



**STATE OF MISSOURI**  
**DEPARTMENT OF HEALTH AND SENIOR SERVICES**

**LEAD OCCUPATION LICENSE REGISTRATION**

Issued to:

**Zachary A. Haselhorst**

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

**Lead Risk Assessor**  
Category of License

Issuance Date: **3/1/2022**  
Expiration Date: **3/1/2024**  
License Number: **160229-300004899**



A handwritten signature in black ink, appearing to read 'Richard W. Moore', is positioned above the printed name.

Richard W. Moore  
Acting Director  
Department of Health and Senior Services



COLLEGE FOR  
**PUBLIC HEALTH & SOCIAL JUSTICE**  
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

**Zachary Haselhorst**

209 E 5th St, Trenton, IL 62293

has attended 8 contact hours of training and successfully passed an examination

**Lead Risk Assessor Refresher**

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117400  
Examination Date: 3/7/2022  
CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104  
(314) 977-8256 [slu.edu/x39753.xml](mailto:slu.edu/x39753.xml)

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

*Christopher C. King*  
**Christopher C. King PhD**  
Director, Center for Environmental  
Education and Training

**State of Missouri**  
**Department of Natural Resources**

**Certificate of Approval**  
**for Chemical Laboratory Service**

This is to certify that

**Teklab, Incorporated**

is hereby approved to perform the analysis of drinking water as specified on the  
Certified Parameter List, which must accompany this certificate to be valid.

Certification Number 930

Date Issued December 13, 2021

Expiration Date January 31, 2025



Laboratory Certification Authority, Public Drinking Water Branch  
Missouri Department of Natural Resources



Laboratory Certification Officer, Environmental Services Program  
Missouri Department of Natural Resources

**MISSOURI DEPARTMENT OF NATURAL RESOURCES**  
**DRINKING WATER LABORATORY**  
**CERTIFIED PARAMETER LIST**

This is to certify that

**Teklab, Incorporated**

located at

**5445 Horseshoe Lake Road, Collinsville, IL 62234**

has been approved to perform the indicated procedures on drinking water under the Missouri Public Drinking Water Regulations (10 CSR 60-5.020). Specific method numbers or references are included in parenthesis when appropriate.

**INORGANIC**

**EPA 335.4**

Total Cyanide

**EPA 353.2**

Nitrate, Nitrite, Total Nitrate and Nitrite

**EPA 245.1**

Mercury

**EPA 200.7**

Barium, Beryllium, Cadmium, Chromium, Copper, Nickel

**EPA 200.8**

Antimony, Arsenic, Barium, Beryllium, Cadmium, Chromium, Copper, Lead, Nickel, Selenium, Thallium

**SM4500F-C**

Fluoride

**SM4500NO2-B**

Nitrite

**Teklab, Incorporated**

**Expiration Date: January 31, 2025**

**Missouri Certificate No.: 930**

**Original Certifying State: Illinois**